

OPERATION & MAINTENANCE MANUAL

DFI No.: D00158

**Facility Type: Water Quality Biofiltration
Swale**



AUGUST, 2011

INDEX

1. IDENTIFICATION..... 1

2. FACILITY CONTACT INFORMATION..... 1

3. CONSTRUCTION..... 1

4. STORM DRAIN SYSTEM AND FACILITY OVERVIEW 1

5. FACILITY HAZ MAT SPILL FEATURE(S)..... 5

6. AUXILIARY OUTLET (HIGH FLOW BYPASS)..... 5

7. MAINTENANCE REQUIREMENTS..... 6

8. WASTE MATERIAL HANDLING..... 6

APPENDIX A: Operational Plan and Profile Drawing(s)

APPENDIX B: ODOT Project Plan Sheets

1. Identification

Drainage Facility ID (DFI): **D00158**
Facility Type: Water Quality Biofiltration Swale
Construction Drawings: (V-File Number) 31V-41
Location: District: 1 (Old 2A)
Highway No.: 102
Mile Post: 90.15 (beg./end)
Description: This facility is located on the east side of OR 47 (Hwy 102), northeast of the intersection of Martin Road and the highway.. Access can be obtained from just north of Martin Road.

2. Facility Contact Information

Contact the Engineer of Record, Region Technical Center, or Geo-Environmental's Senior Hydraulics Engineer for:

- Operational clarification
- Maintenance clarification
- Repair or restoration assistance

Engineering Contacts:

Region Technical Center Hydro Unit Manager

Or

Geo-Environmental Senior Hydraulics Engineer (503) 986-3365.

3. Construction

Engineer of Record: County Designer - Washington County
Engineering, Jim Perkins, P.E., 503-846-7900

Facility construction: 1998
Contractor: Huffman-Wright Construction Company

4. Storm Drain System and Facility Overview

A water quality swale is a flat-bottomed open channel designed to treat stormwater runoff from highway pavement areas. This type of facility is lined with grass. Treatment by trapping sedimentation occurs when stormwater runoff flows through the grass.

This facility is located on the east side of OR 47 (Hwy 102), northeast of the intersection of Martin Road and the highway.

The swale treats stormwater runoff on both sides of the highway for a distance of approximately 1,050 feet. Stormwater runoff is conveyed by a roadway ditch on both sides and collected by a series of inlets at a low (sag) point in the highway.

A split-flow manhole located upstream of the facility (Point A of the Operational Plan, Appendix A) is used to bypass the water quality flows into the facility and convey the high flows through a series of separate pipes, ranging from 18 to 36-inches in diameter. This conveyance system discharges the higher flows to a pond east of Martin Road and eventually into Council Creek. The high flows do not receive treatment.

The low flows are first pretreated through a pollution control manhole (Point B in the Operational Plan) before being conveyed by a 12-inch storm pipe to the water quality swale. The treated stormwater leaves the water quality swale through an open channel/grassy field and is ultimately discharged into Council Creek.

A. Maintenance equipment access:

Maintenance access can be obtained from US 47 (Hwy 102). A paved maintenance driveway is located along the highway just north of the intersection with Martin Road.

B. Heavy equipment access into facility:

- Allowed (no limitations)
- Allowed (with limitations) – Facility is located within BPA easement
- Not allowed

C. Special Features:

- Amended Soils
- Porous Pavers
- Liners
- Underdrains

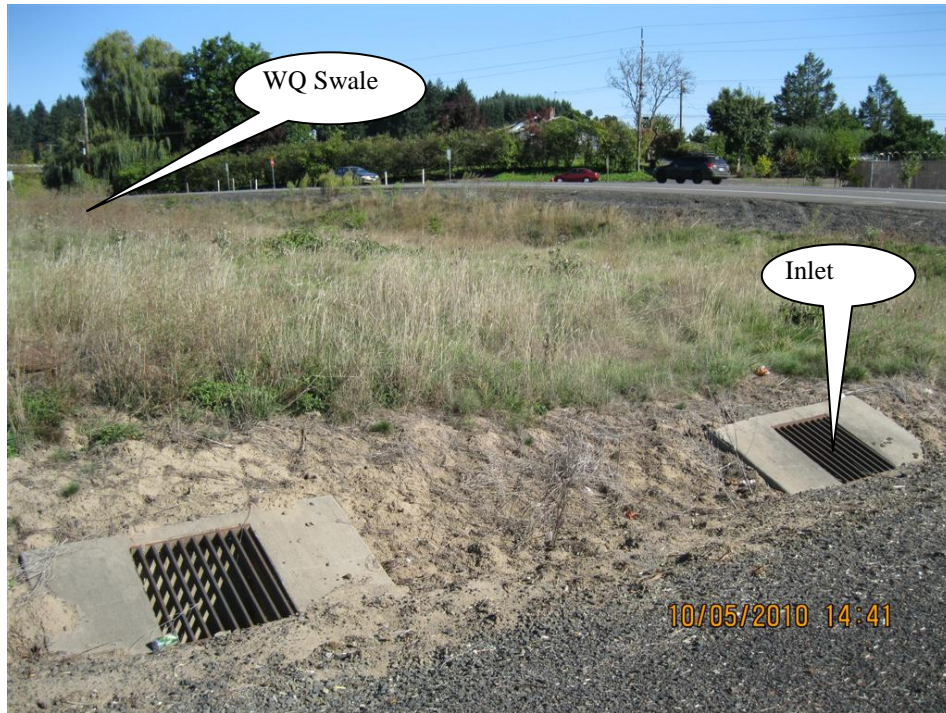


Photo 1: Looking east at the inlets along OR 47 (Hwy 102). Martin Road is in the background.



Photo 2: High-Low Flow Split Structure at the intersection of Martin Road and OR 47 (Hwy 102).



Photo 3: Looking north at the 12-inch diameter facility inlet to the WQ biofiltration swale. I-5 is located to the right.



Photo 4: Looking west toward the facility inlet, leading into the WQ biofiltration swale.

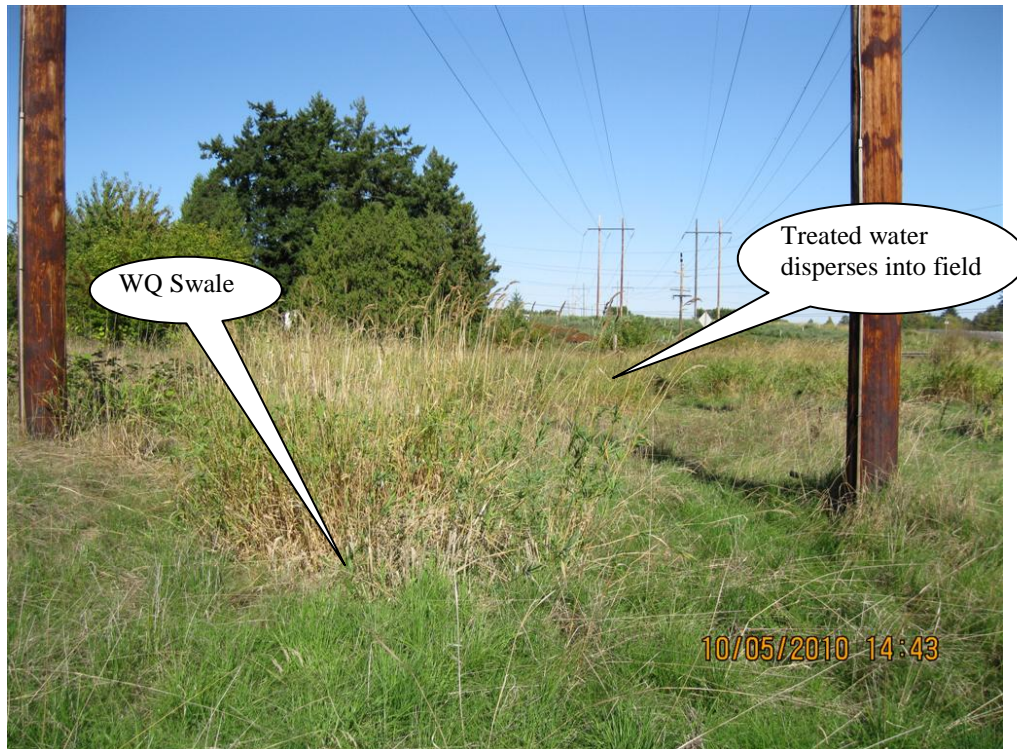


Photo 5: Looking northeast at the WQ biofiltration swale with the Bonneville Power Administration transmission lines and poles above.

5. Facility Haz Mat Spill Feature(s)

The swale can not be effectively used to store a volume of liquid. The swale disperses the runoff to a nearby field with no outlet control.

6. Auxiliary Outlet (High Flow Bypass)

Auxiliary Outlets are provided if the primary outlet control structure can not safely pass the projected high flows. Broad-crested spillway weirs and over flow risers are the two most common auxiliary outlets used in stormwater treatment facility design. The auxiliary outlet feature is either a part of the facility or an additional storm drain feature/structure.

The auxiliary outlet feature for this facility is:

Designed into facility

Other, as noted –

There are no auxiliary outlet features provided for in this facility

7. Maintenance Requirements

Routine maintenance table for non-proprietary stormwater treatment and storage/detention facilities have been incorporated into ODOT's Maintenance Guide. These tables summarize the maintenance requirements for ponds, swales, filter strips, bioslopes, and detention tanks and vaults. Special maintenance requirements in addition to the routine requirements are noted below when applicable.

The ODOT Maintenance Guide can be viewed at the following website:

<http://www.oregon.gov/ODOT/HWY/OOM/MGuide.shtml>

Maintenance requirements for proprietary structures, such as underground water quality manholes and/or vaults with filter media are noted in Appendix C when applicable.

The following stormwater facility maintenance table (See ODOT Maintenance Guide) should be used to maintain the facility outlined in this Operation and Maintenance Manual or follow the Maintenance requirements outlined in Appendix C when proprietary structure is selected below:

- Table 1 (general maintenance)
- Table 2 (stormwater ponds)
- Table 3 (water quality biofiltration swales)
- Table 4 (water quality filter strips)
- Table 5 (water quality bioslopes)
- Table 6 (detention tank)
- Table 7 (detention vault)
- Appendix C (proprietary structure)
- Special Maintenance requirements:

Note: Special maintenance Requirements Require Concurrence from ODOT SR Hydraulics Engineer.

8. Waste Material Handling

Material removed from the facility is defined as waste by DEQ. Refer to the roadwaste section of the ODOT Maintenance Yard Environmental Management System (EMS) Policy and Procedures Manual for disposal options: <http://egov.oregon.gov/ODOT/HWY/OOM/EMS.shtml>


Contact any of the following for more detailed information about management of waste materials found on site:

ODOT Clean Water Unit	(503) 986-3008
ODOT Statewide Hazmat Coordinator	(503) 229-5129
ODOT Region Hazmat Coordinator	(503) 731-8290
ODEQ Northwest Region Office	(503) 229-5263

Appendix A

Content:

- **Operational Plan and Profile Drawing(s)**

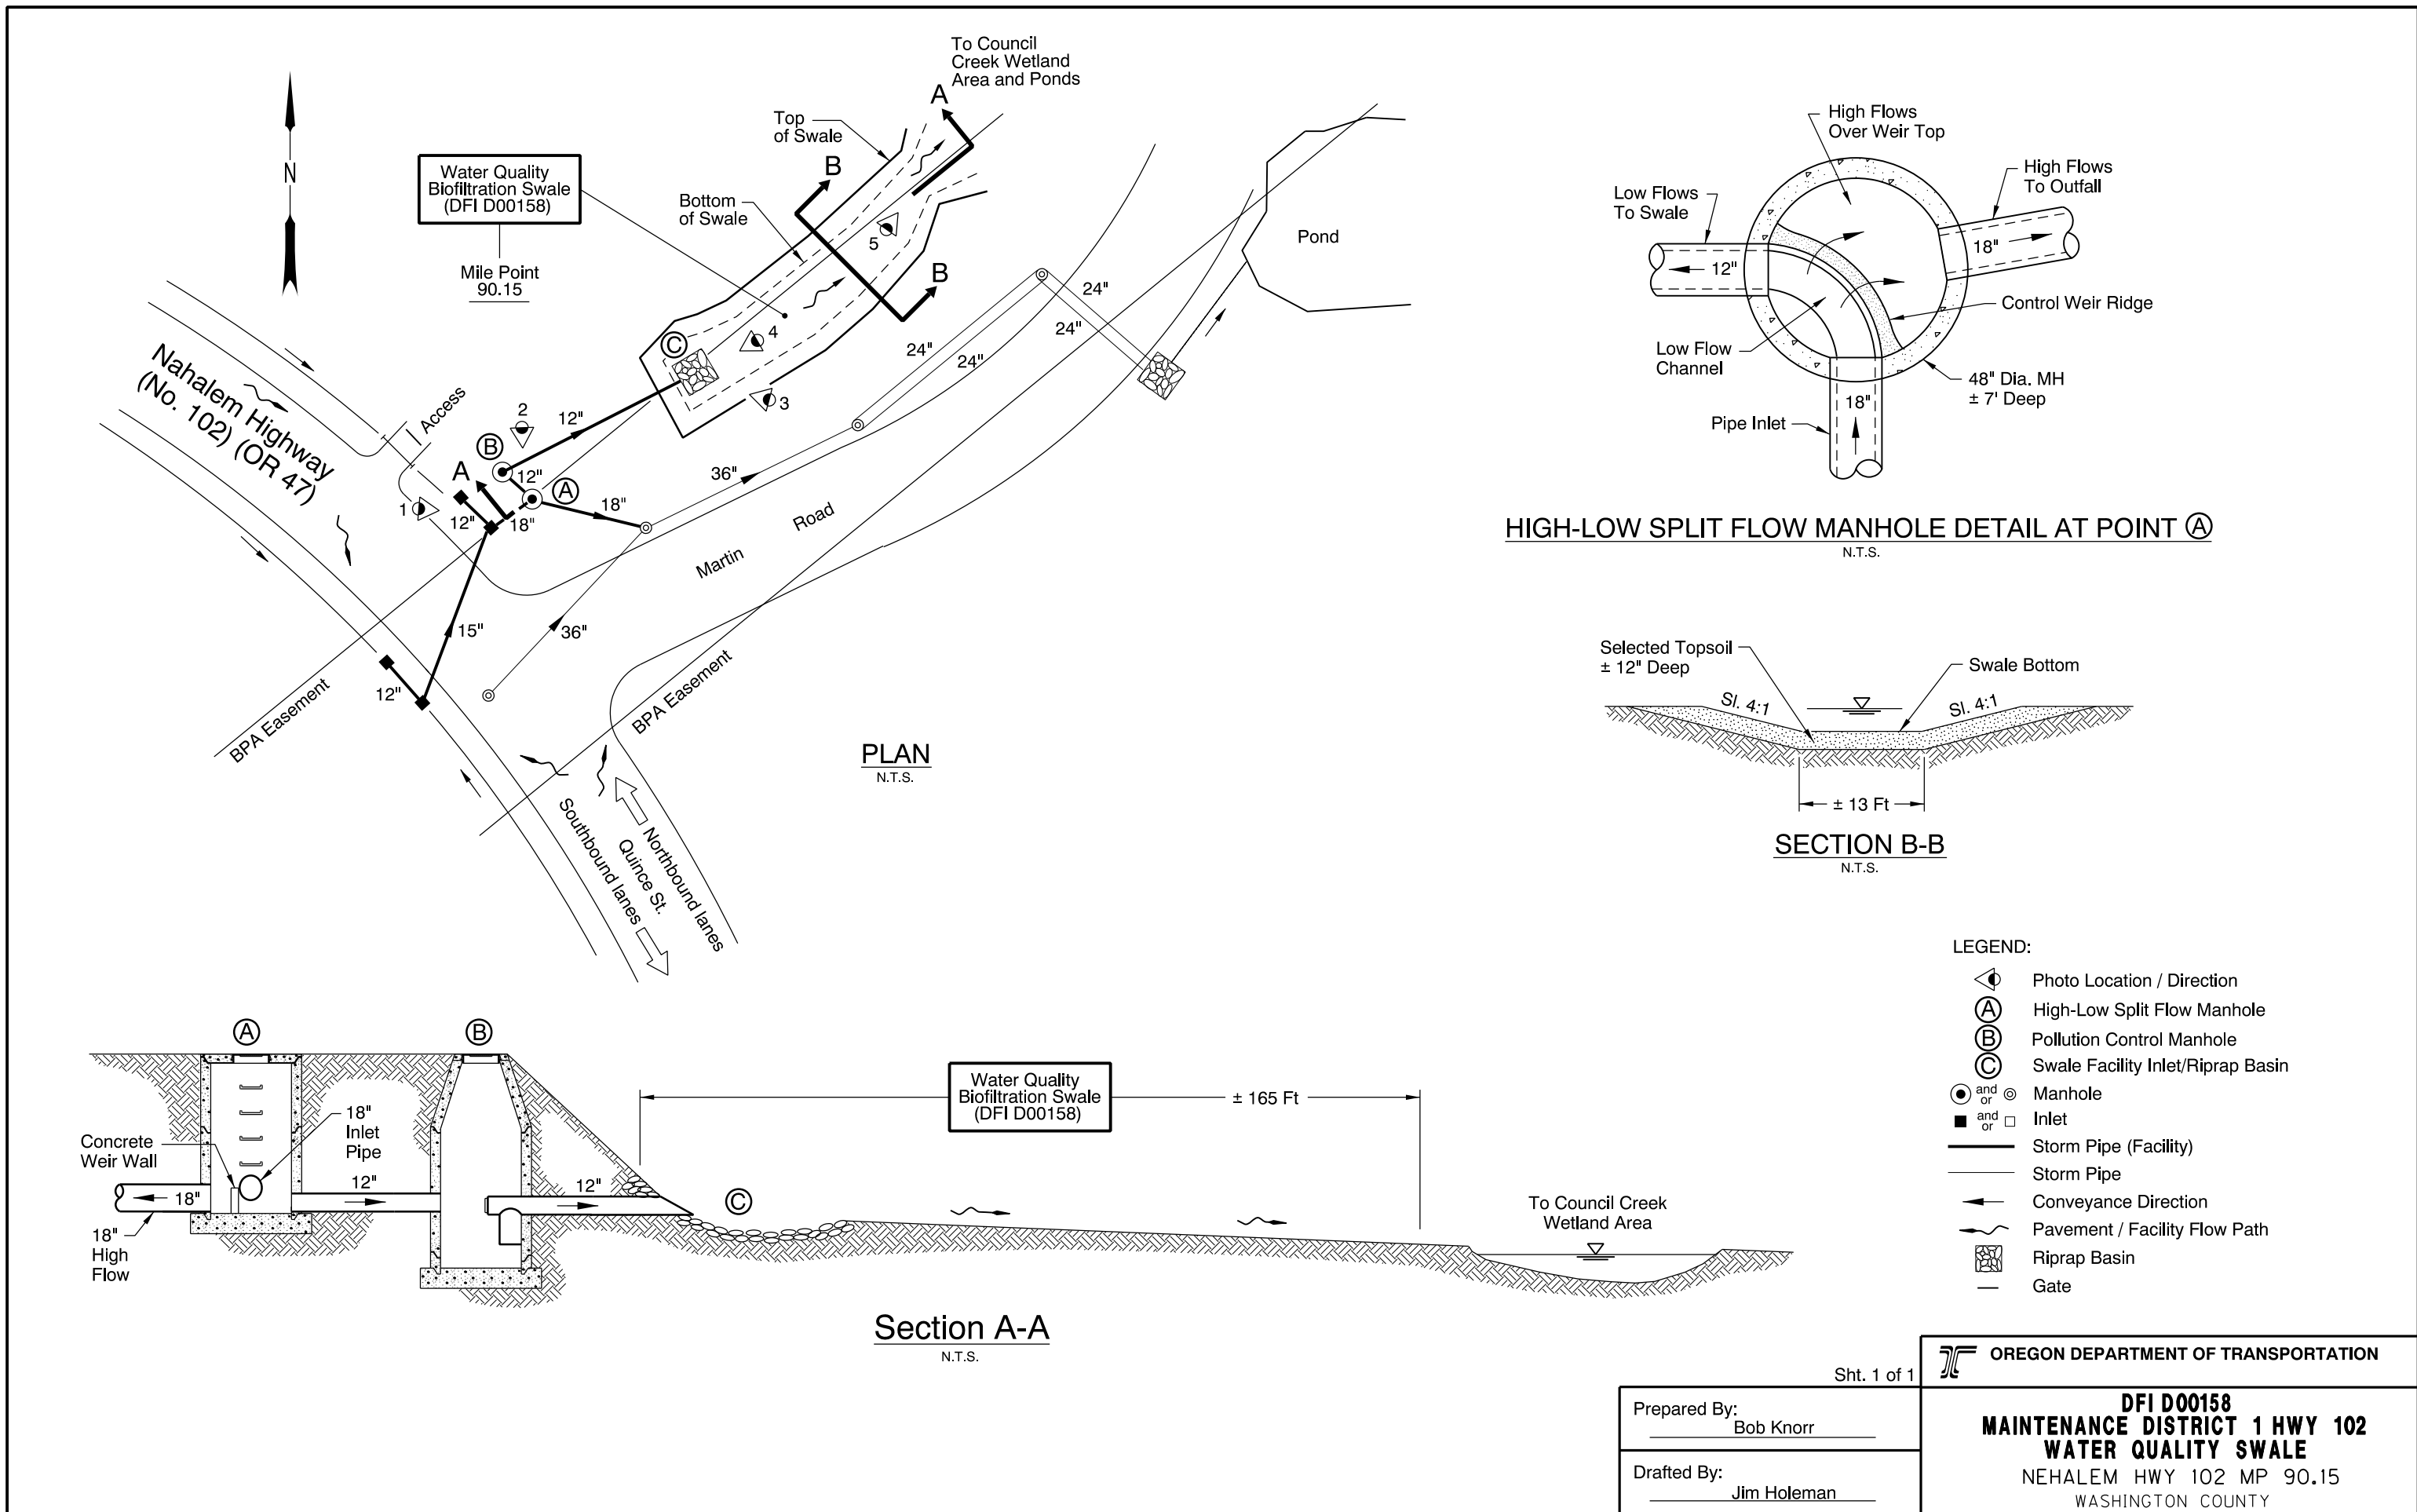

Water Quality Biofiltration Swale (DFI D00158)

Mile Point 90.15

Water Quality Biofiltration Swale (DFI D00158)

Section A-A
N.T.S.

SECTION B-B
N.T.S.

HIGH-LOW SPLIT FLOW MANHOLE DETAIL AT POINT A
N.T.S.

PLAN
N.T.S.

- LEGEND:
- Photo Location / Direction
 - High-Low Split Flow Manhole
 - Pollution Control Manhole
 - Swale Facility Inlet/Riprap Basin
 - Manhole
 - Inlet
 - Storm Pipe (Facility)
 - Storm Pipe
 - Conveyance Direction
 - Pavement / Facility Flow Path
 - Riprap Basin
 - Gate

Sht. 1 of 1

OREGON DEPARTMENT OF TRANSPORTATION

Prepared By: Bob Knorr

Drafted By: Jim Holeman

DFI D00158
MAINTENANCE DISTRICT 1 HWY 102
WATER QUALITY SWALE
 NEHALEM HWY 102 MP 90.15
 WASHINGTON COUNTY

Appendix B

Content:

- **ODOT Project Plan Sheets**
 - *Cover/Title Sheet*
 - *Water Quality/Detention Plan Sheets*
 - *Other Details*


STATE OF OREGON
DEPARTMENT OF TRANSPORTATION

PLANS FOR PROPOSED PROJECT

GRADING, STRUCTURE, PAVING, SIGNING, SIGNAL, & STRIPING

**COUNCIL CR. - QUINCE ST.
(FOREST GROVE) SEC.**

**NEHALEM HIGHWAY
WASHINGTON COUNTY
OCTOBER 1998**

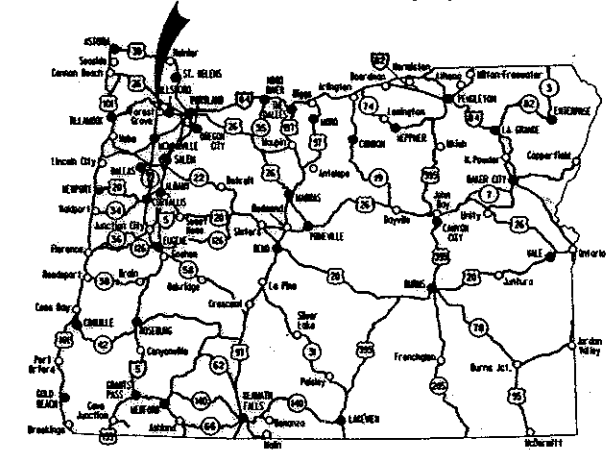

Overall Length Of Project - 3.33 km (2.07 Miles)

ATTENTION:
Oregon Law Requires You To Follow Rules
Adopted By The Oregon Utility Notification Center.
Those Rules Are Set Forth In OAR 952-001-0010 Through
OAR 952-001-0090. You May Obtain Copies Of The Rules From The Center.

INDEX OF SHEETS	
SHEET NO.	DESCRIPTION
1	Title Sheet
1A	Index Of Sheets Cont'd. & Standard Drawing Nos.
1B	Sheet Layout
2, 2A Thru 2A-9 Incl.	Typical Sections
2B Thru 2B-20 Incl.	Details
2C Thru 2C-9 Incl.	Traffic Control Plans
2D Thru 2D-3 Incl.	Erosion Control Details
2D Thru 2D-18 Incl.	Erosion Control Plans
2E Thru 2E-4 Incl.	Pipe Data
2F	Summary
3	Alignment & General Construction
3A	Drainage & Utilities
3B	Profile
4	Alignment & General Construction
4A, 4A-2	Drainage & Utilities
4B, 4C, 4D	Alignment & General Construction
4E	Drainage & Utilities
4F, 4G	Profile
5	Alignment & General Construction
5A	Drainage & Utilities
5B	Profile
6	Alignment & General Construction
6A, 6A-2	Drainage & Utilities
6B	Profile
7	Alignment & General Construction
7A, 7A-2	Drainage & Utilities
7B	Profile
8	Alignment & General Construction
8A, 8A-2	Drainage & Utilities
8B	Profile
9	Alignment & General Construction
9A, 9A-2	Drainage & Utilities
9B, 9C	Profiles
10	Alignment & General Construction
10A, 10A-2	Drainage & Utilities
10B, 10C	Profiles
11	Alignment & General Construction
11A, 11A-2	Drainage & Utilities
11B	Alignment & General Construction
11C	Drainage & Utilities
11D, 11E	Profiles
12	Alignment & General Construction
12A, 12A-2	Drainage & Utilities
12B	Profile


**NH-S102(4)
END OF PROJECT**
STA. "L" 4+130
(M.P. 17.88 - Hwy. No. 29)



**NH-S102(4)
BEGINNING OF PROJECT**
STA. "L" 1+000
(M.P. 88.69 - Hwy. No. 102)

- OREGON TRANSPORTATION COMMISSION
- Henry H. Hewitt CHAIRMAN
 - Susan Brody VICE CHAIRMAN
 - Steven H. Corey COMMISSIONER
 - Stuart Foster COMMISSIONER
 - John Russell COMMISSIONER
 - Grace Crunican DIRECTOR OF TRANSPORTATION

PLANS PREPARED BY:
WASHINGTON COUNTY


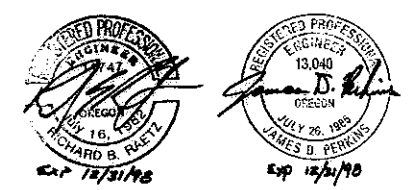


OREGON DEPARTMENT OF TRANSPORTATION
CONCURRENCE

[Signature] 9/29/98
TECHNICAL SERVICES MANAGING ENGINEER DATE

**COUNCIL CR. - QUINCE ST.
(FOREST GROVE) SEC.
NEHALEM HIGHWAY
WASHINGTON COUNTY**

FEDERAL HIGHWAY ADMINISTRATION	PROJECT NUMBER	SHEET NO.
REGION 10	OREGON DIVISION	1

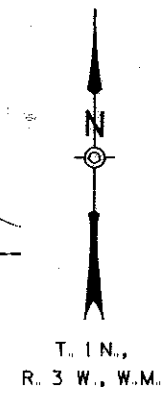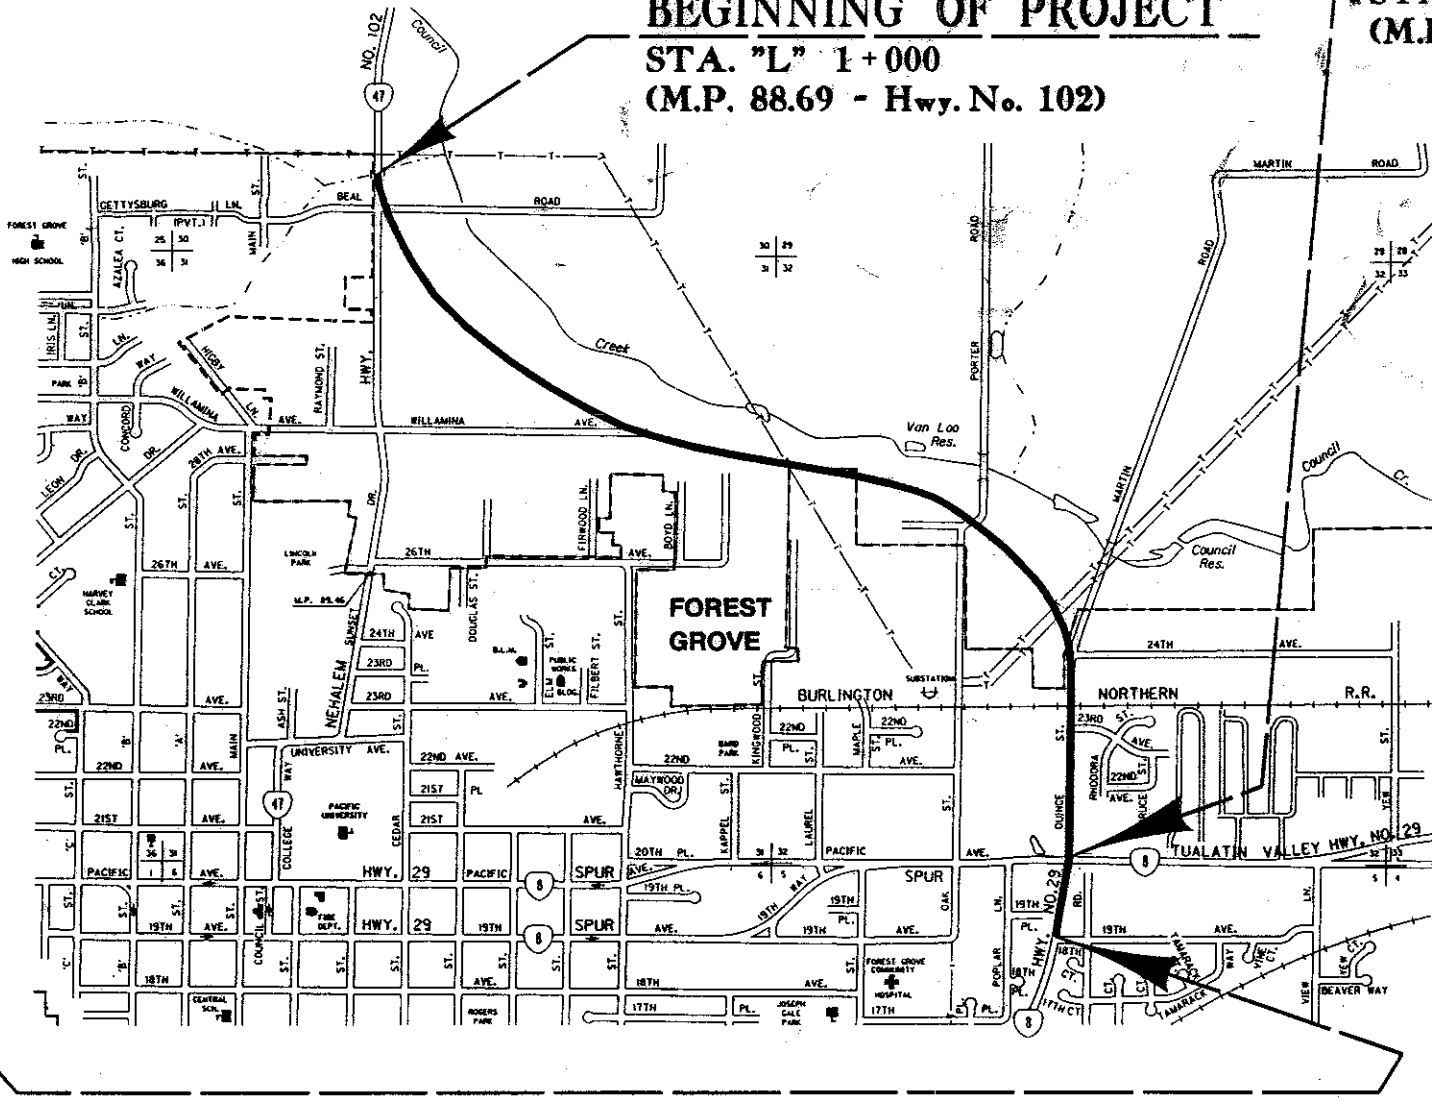


END OF CONTRACT PROJECT
STA. "L" 4+327.1
(M.P. 17.76 - Hwy. No. 29)

25-SEP-1998 10:20


C:\US1\p\o\ec\34\354r1.mcd



OUTLET BASIN

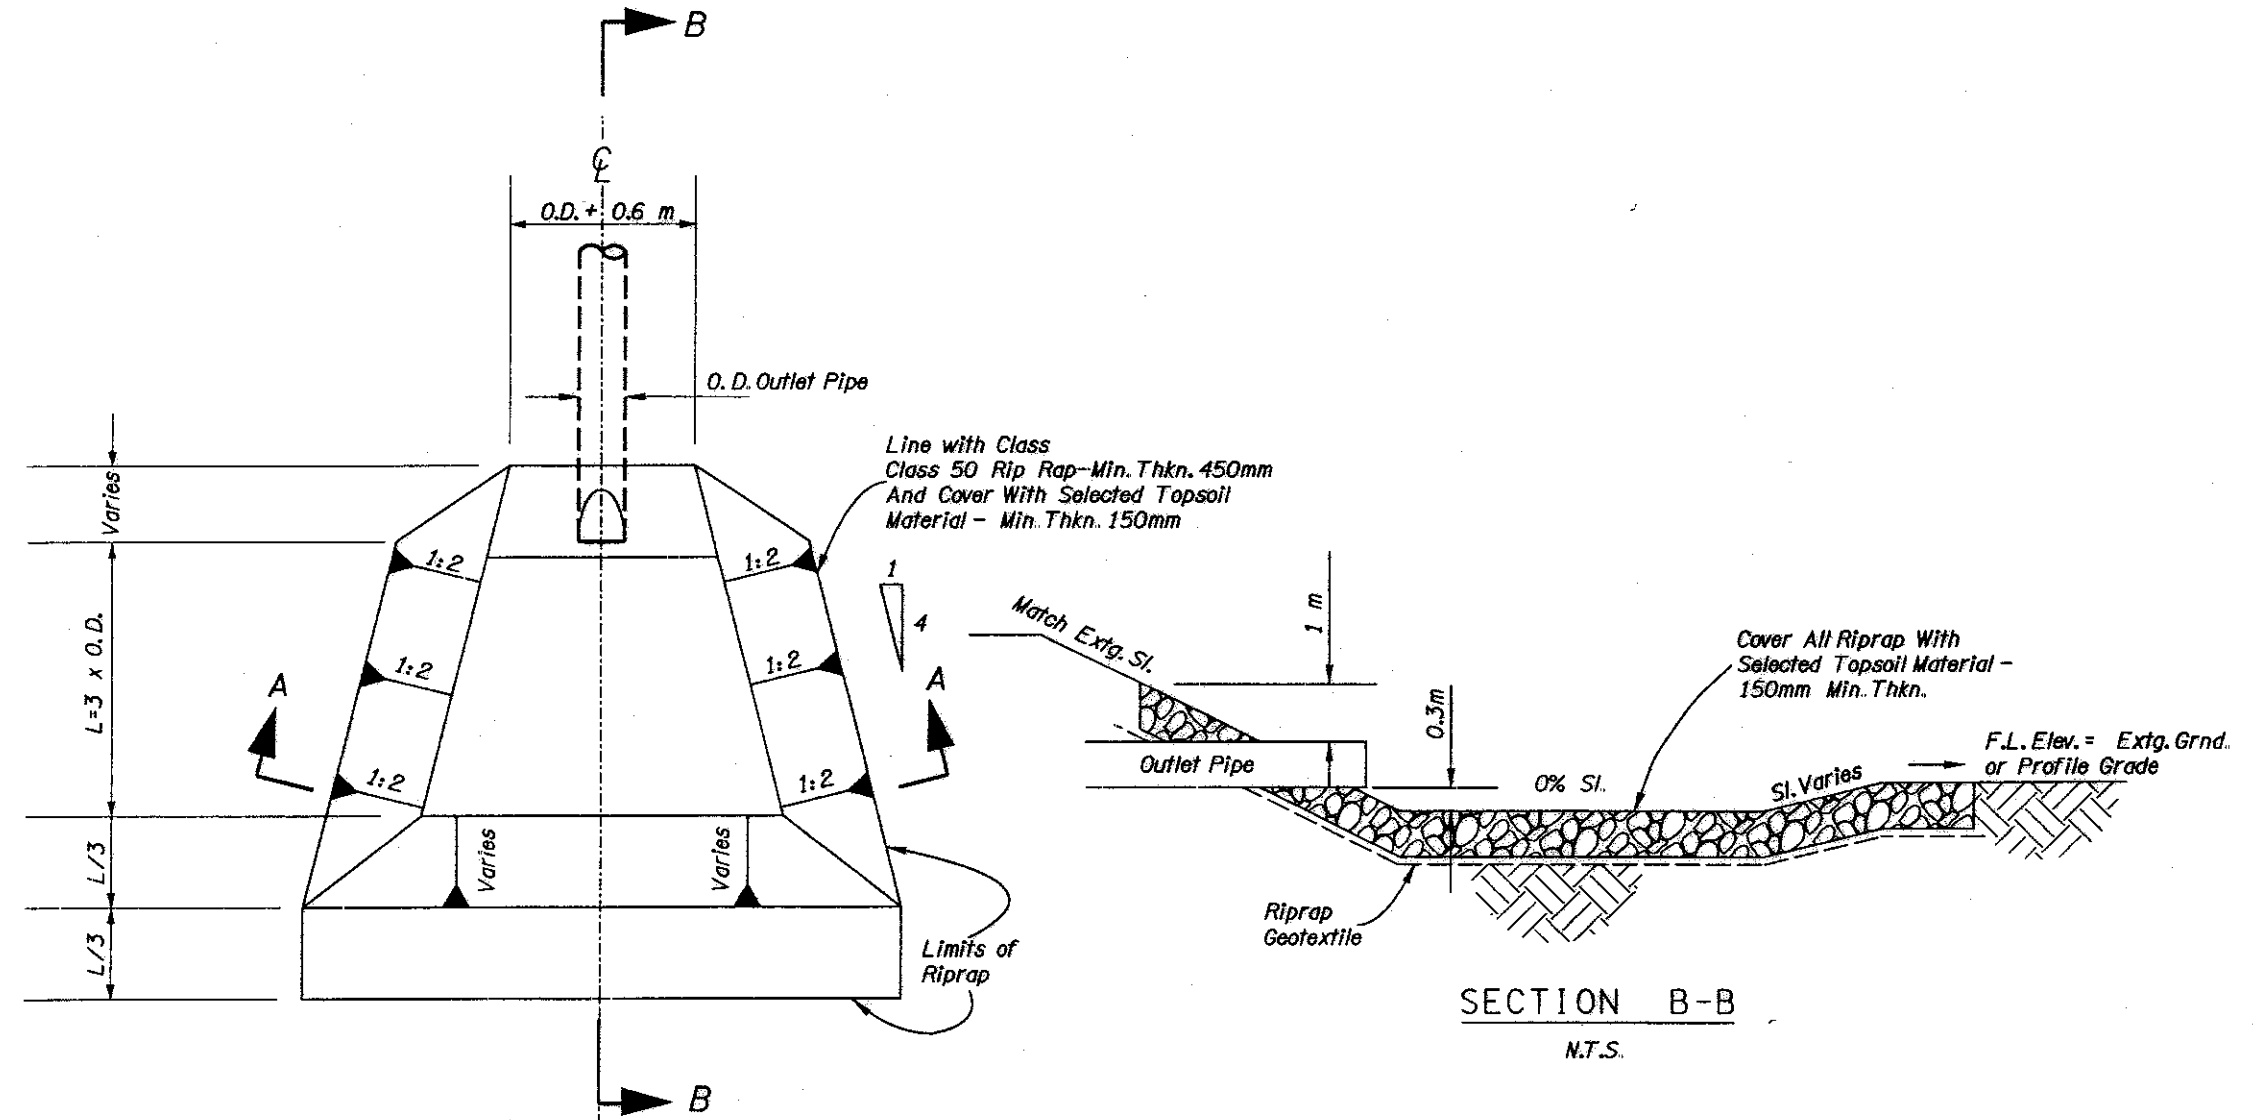

PLAN
N.T.S.

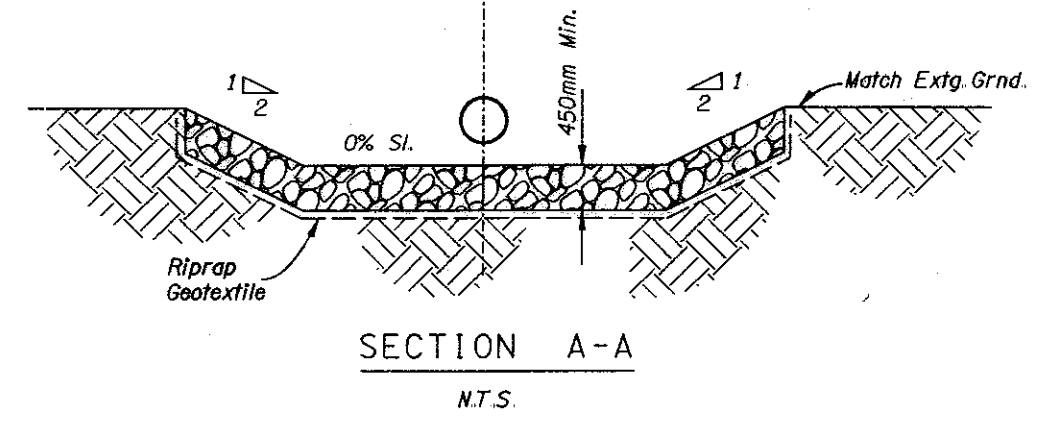

20 AUG 98

0222417 04364043641.dwg

VIEW 1





COUNCIL CR.-QUINCE ST. (FOREST GROVE) SEC. NEHALEM HWY. WASHINGTON COUNTY			
FEDERAL HIGHWAY ADMINISTRATION		PROJECT NUMBER	SHEET NO.
REGION 10	OREGON DIVISION	NH-S102 (4)	2B-6



CONTROL MANHOLE

Sta.	Sheet/Note	Top Weir Elev.	Flow Line Pipe Elevation		
			Inlet	High Flow	Low Flow
1+457	4A-2 Note 6	49.280	49.120	49.100	49.100
1+848	6A-2 Note 7	49.400	49.246	49.220	49.220
2+155	7A-2 Note 5	49.250	49.080	49.070	49.070
2+566	8A-2 Note 6	48.980	48.817	48.800	48.800
2+805	9A-2 Note 6	50.350	50.175	50.170	50.170
3+385	11A-2 Note 3	48.825	48.665	48.645	48.645

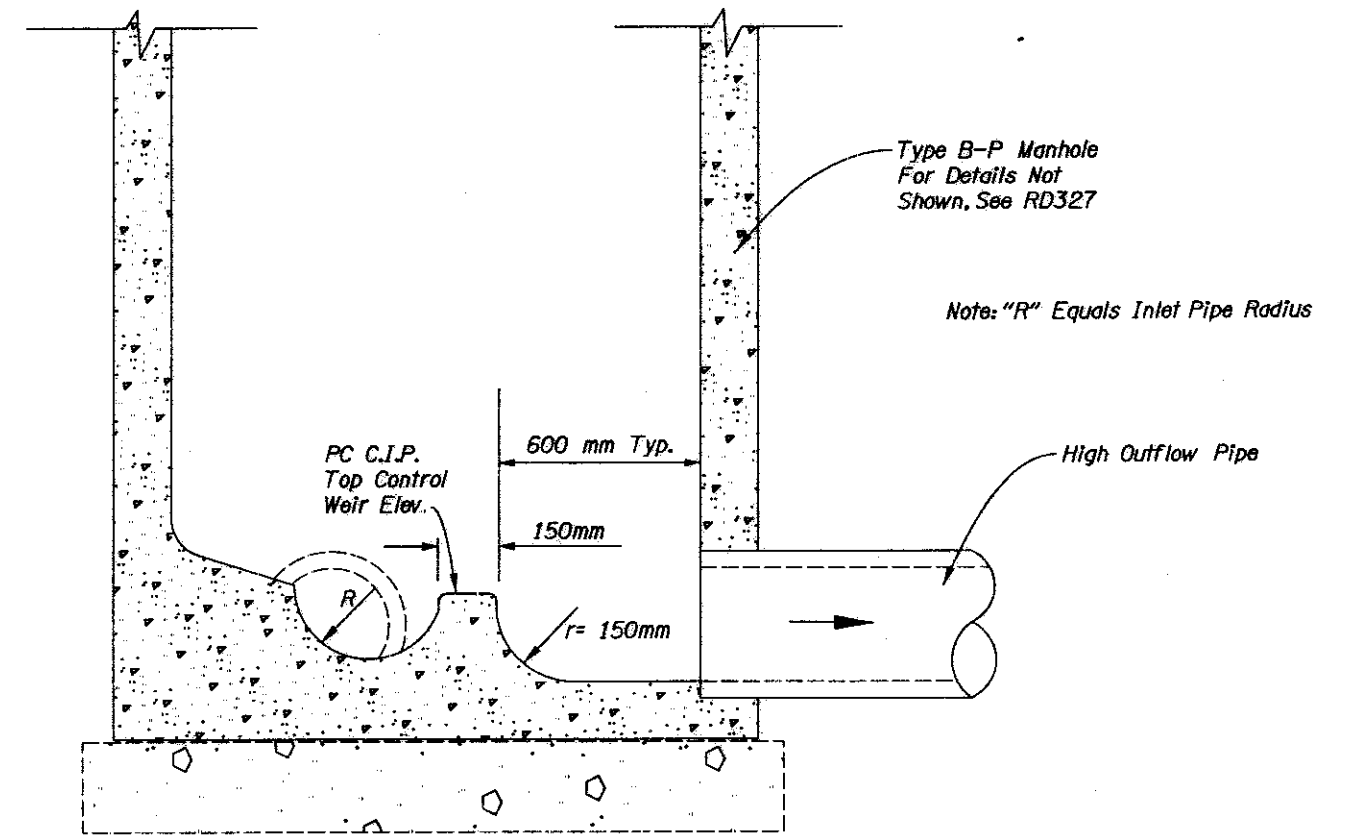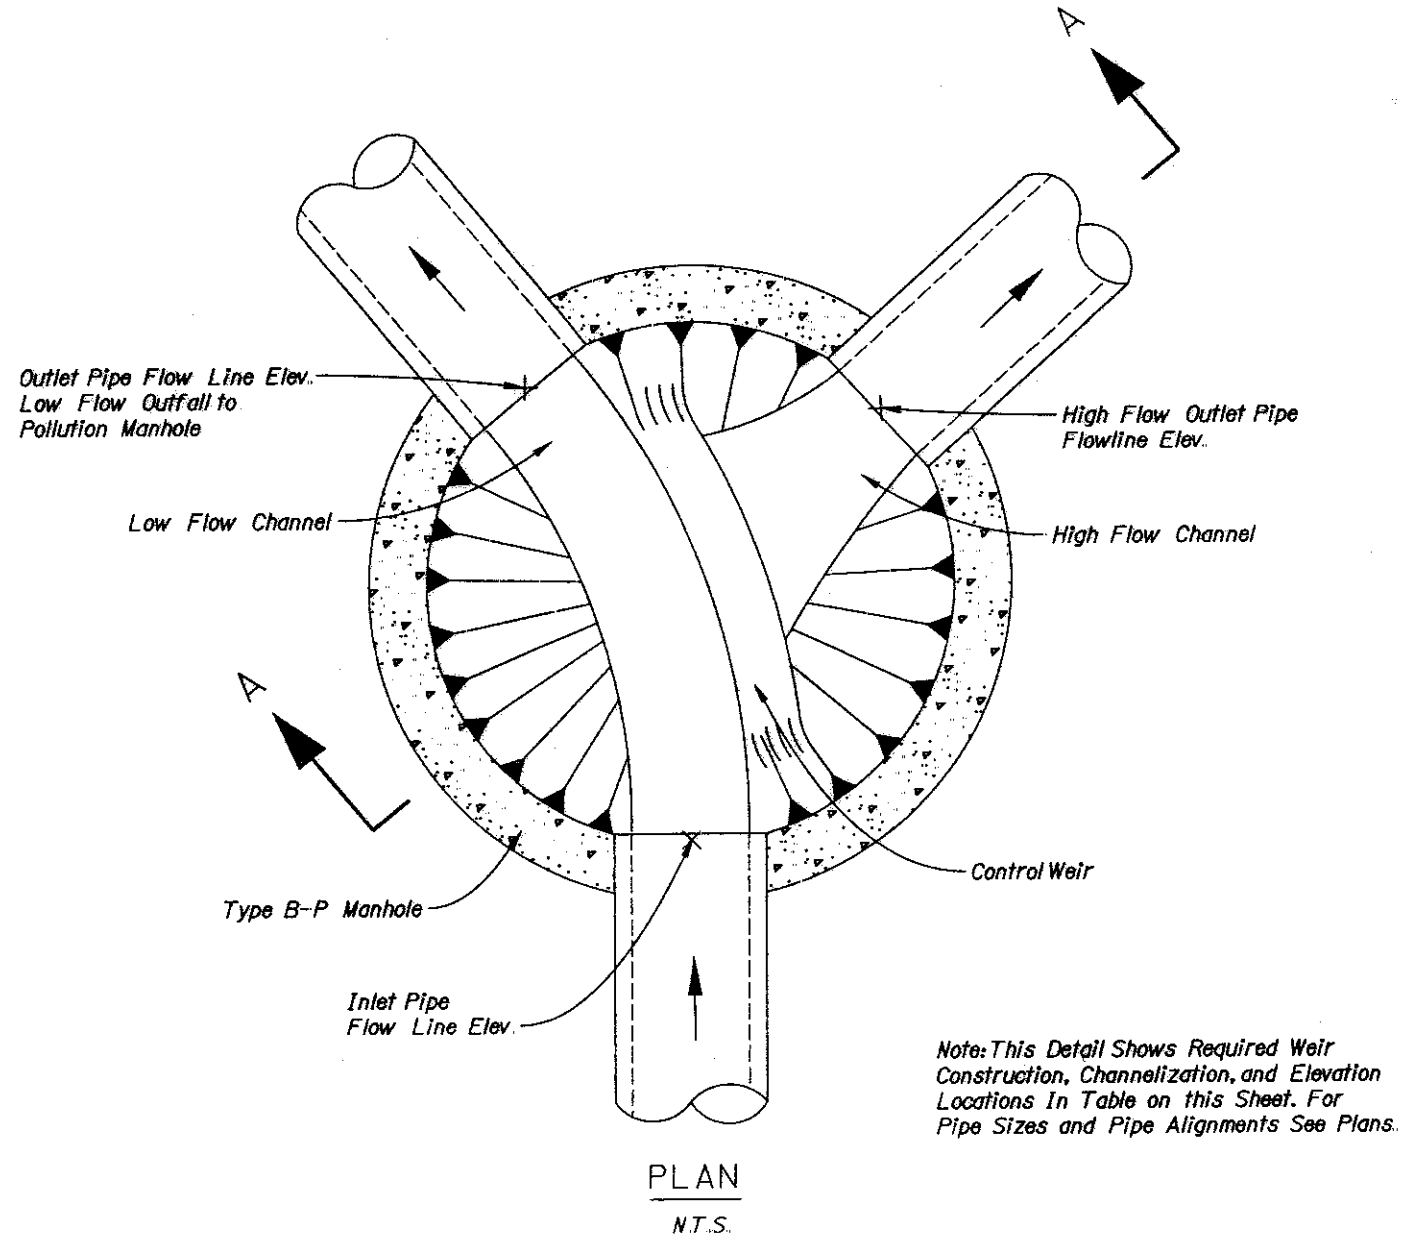

20 AUG 98

0122410043660436412




COUNCIL CR.-QUINCE ST. (FOREST GROVE) SEC.			
NEHALEM HWY.			
WASHINGTON COUNTY			
FEDERAL HIGHWAY ADMINISTRATION	PROJECT NUMBER	SHEET NO.	
REGION 10	OREGON DIVISION	NH-S102 (4)	2B-8



DETAILS


WATER QUALITY MANHOLE

"All Dimensions Are In mm Unless Otherwise Noted"

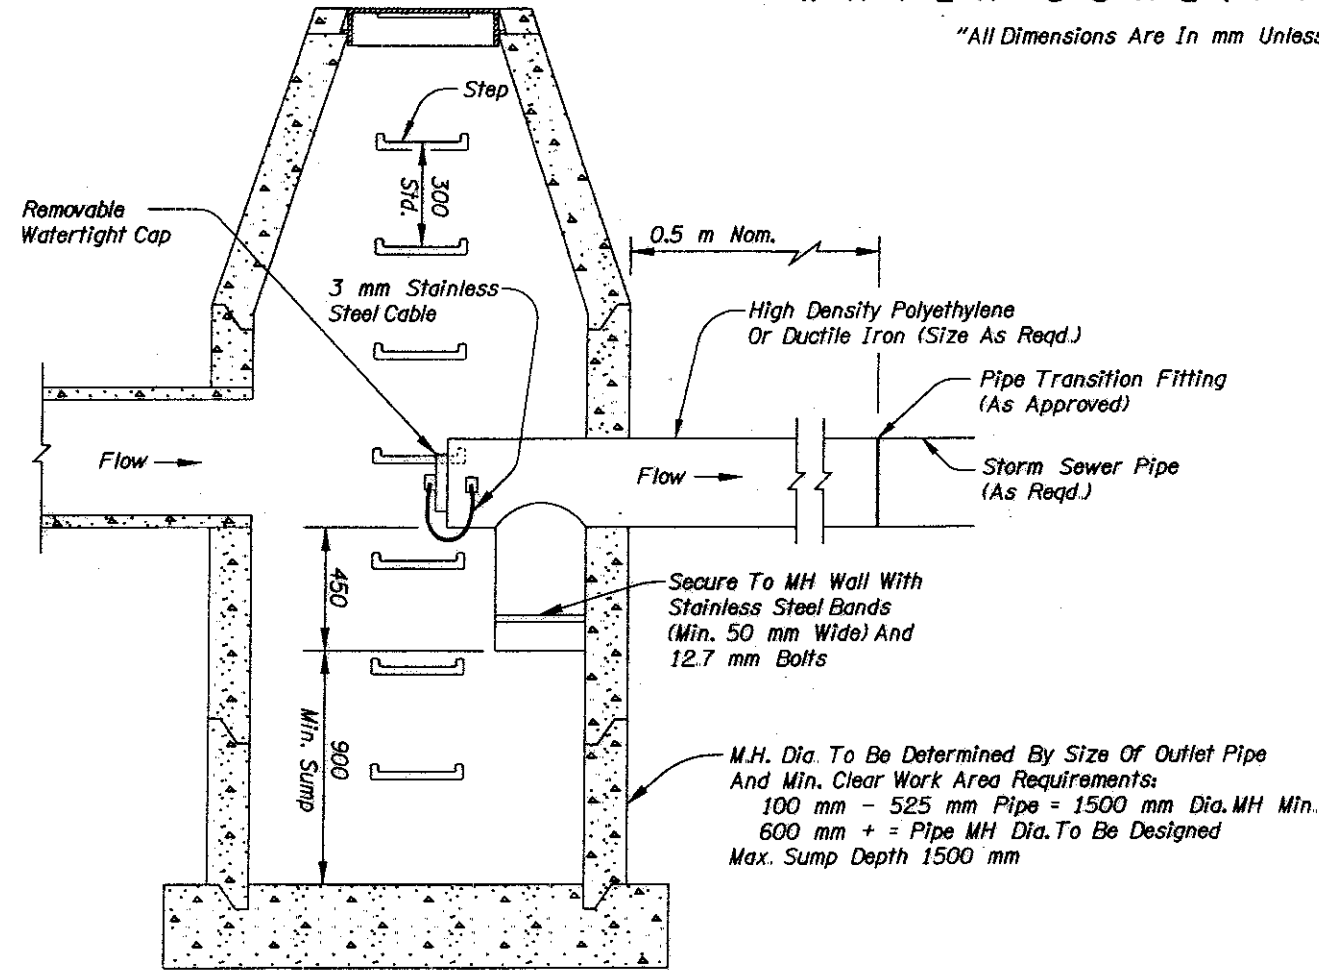


SECTION A-A

(For Details Not Shown, See USA Standard Manhole Drawing 010-ST)

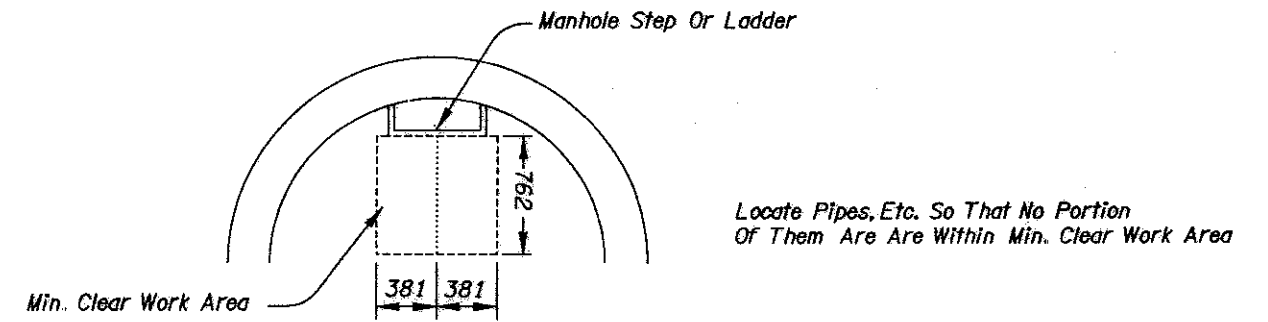

DETAIL "A"

Locate Pipes, Etc. So That No Portion Of Them Are Within Min. Clear Work Area

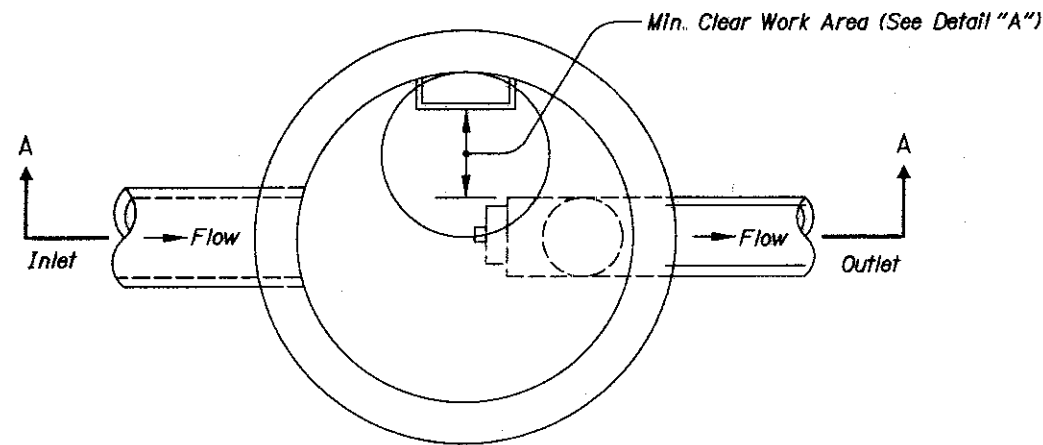

PLAN

NOTES:

1. Hardware, Fasteners And Anchors To Be Stainless Steel; Use 3 mm Stainless Steel Cable
2. See Pipe Data Sheet And Plan Sheets For Pipe Size(s).
3. See Pipe Data Sheet And Plan Sheets For Manhole Size(s).
4. See Pipe Data Sheet And Plan Sheets For Sump Depth.
5. Manhole And Base Per Manhole Standard Drawings.
6. Hardware, Fasteners, Anchors, Fittings, Appurtenances, Labor And Equipment Is Incidental To Water Quality Manhole Item.



COUNCIL CR.-QUINCE ST. (FOREST GROVE) SEC.			
NEHALEM HWY.			
WASHINGTON COUNTY			
FEDERAL HIGHWAY ADMINISTRATION	PROJECT NUMBER	SHEET NO.	
REGION 10	OREGON DIVISION	NH-S102 (4)	2B-9



20 AUG 98

0224170-0436-0436-02




SWALE NO. 7 DETAILS

(For Location, See Sht. 11A-2, Note 10)

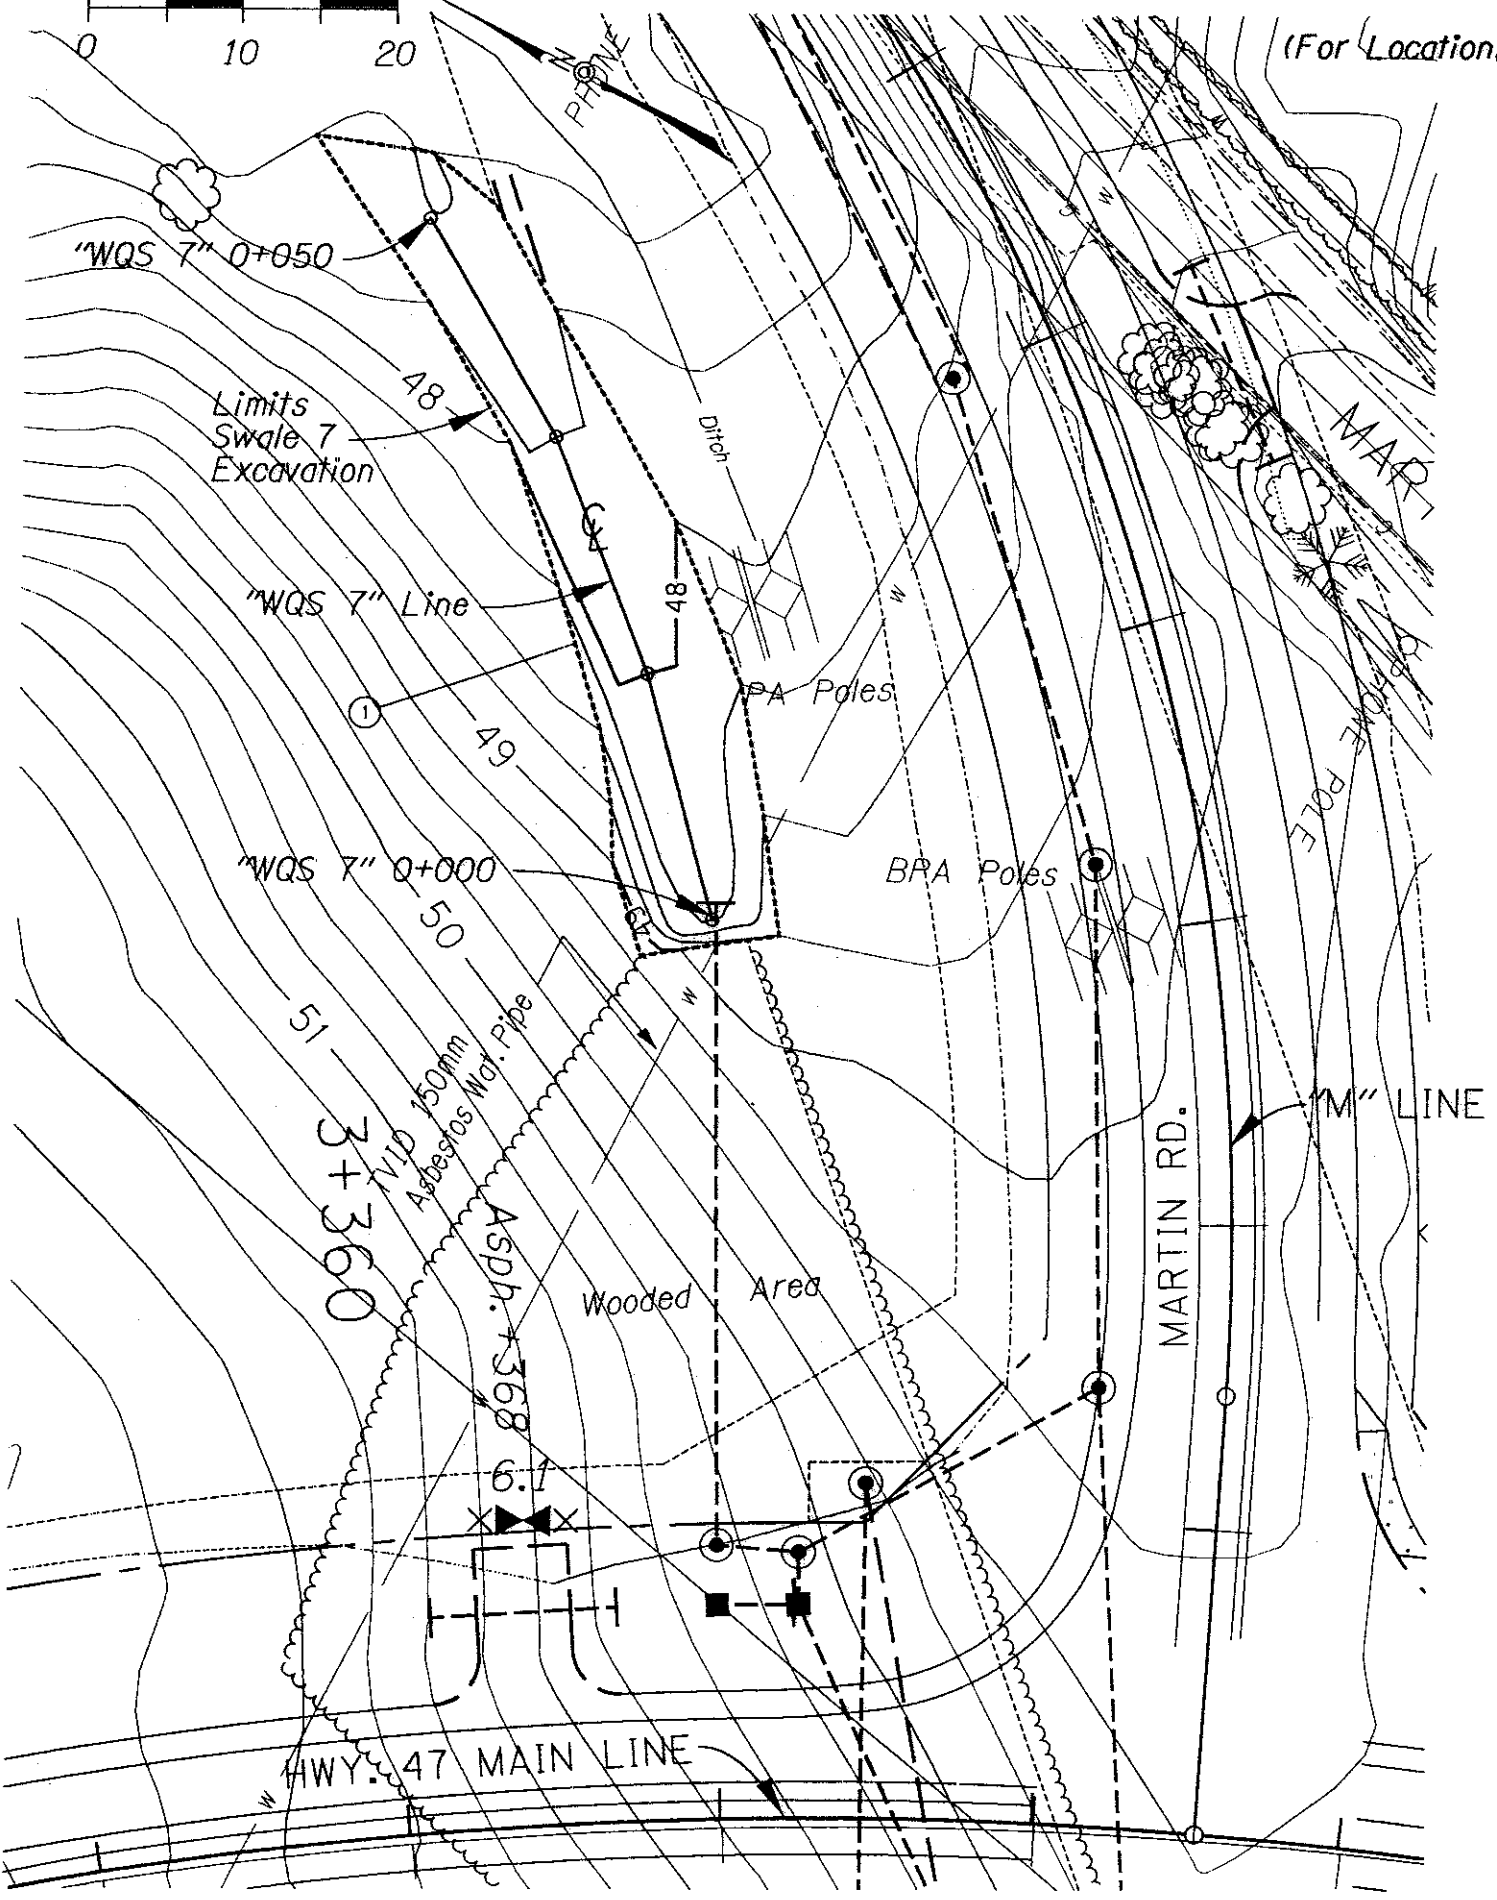


"W.Q.S. 7" LINE

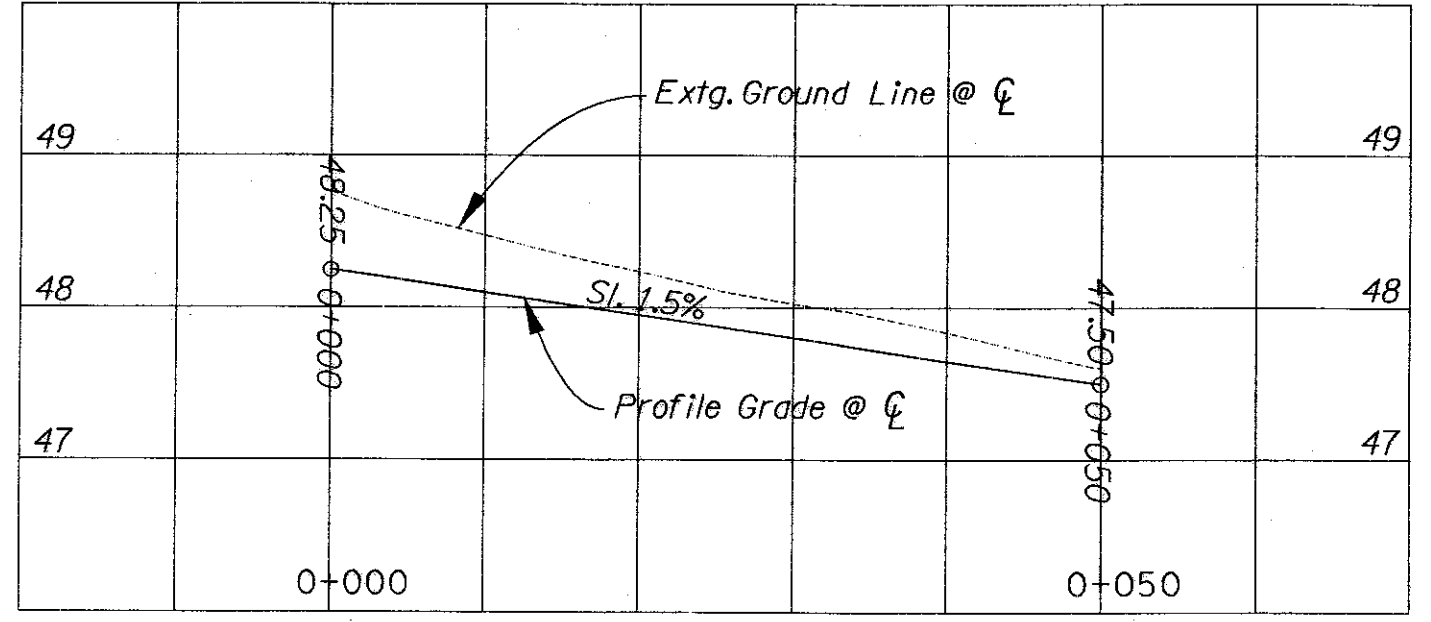

① Const. Water Quality Swale
Swale Exc. - 93 m³
Selected Topsoil - 75 m³

"W.Q.S. 7"

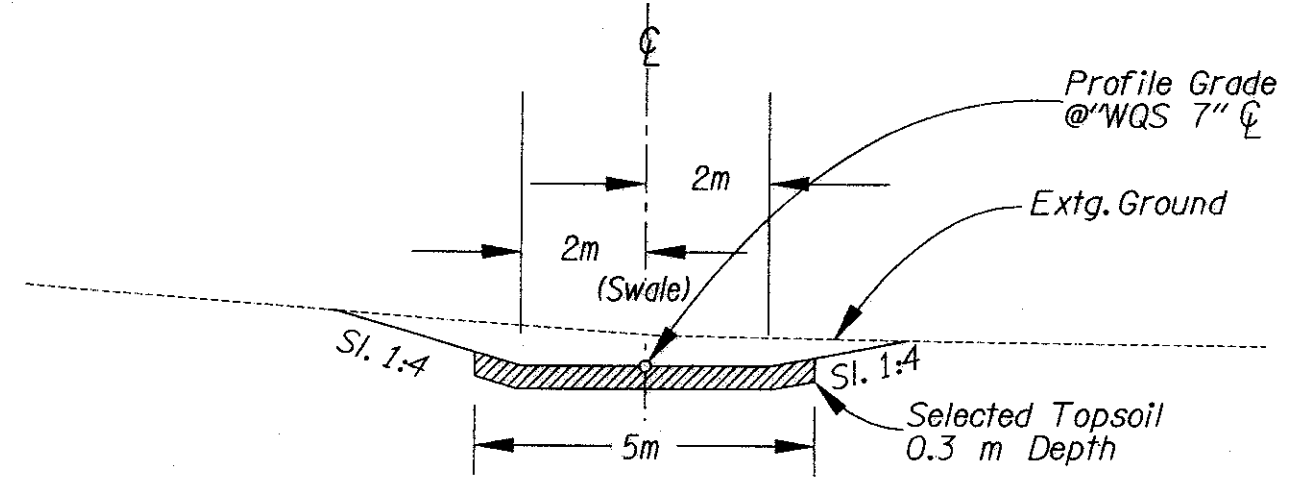

STA. "WQS 7" 0+000 TO STA. "WQS 7" 0+050

20 AUG 98

012241004364036413

VIEW 5




COUNCIL CR.-QUINCE ST. (FOREST GROVE) SEC.
NEHALEM HWY.
WASHINGTON COUNTY

FEDERAL HIGHWAY ADMINISTRATION		PROJECT NUMBER	SHEET NO.
REGION 10	OREGON DIVISION	NH-S102 (4)	2B-16

DRAINAGE & UTILITIES

Sec. 32, T. 1N, R. 3W, WM.

31V-41

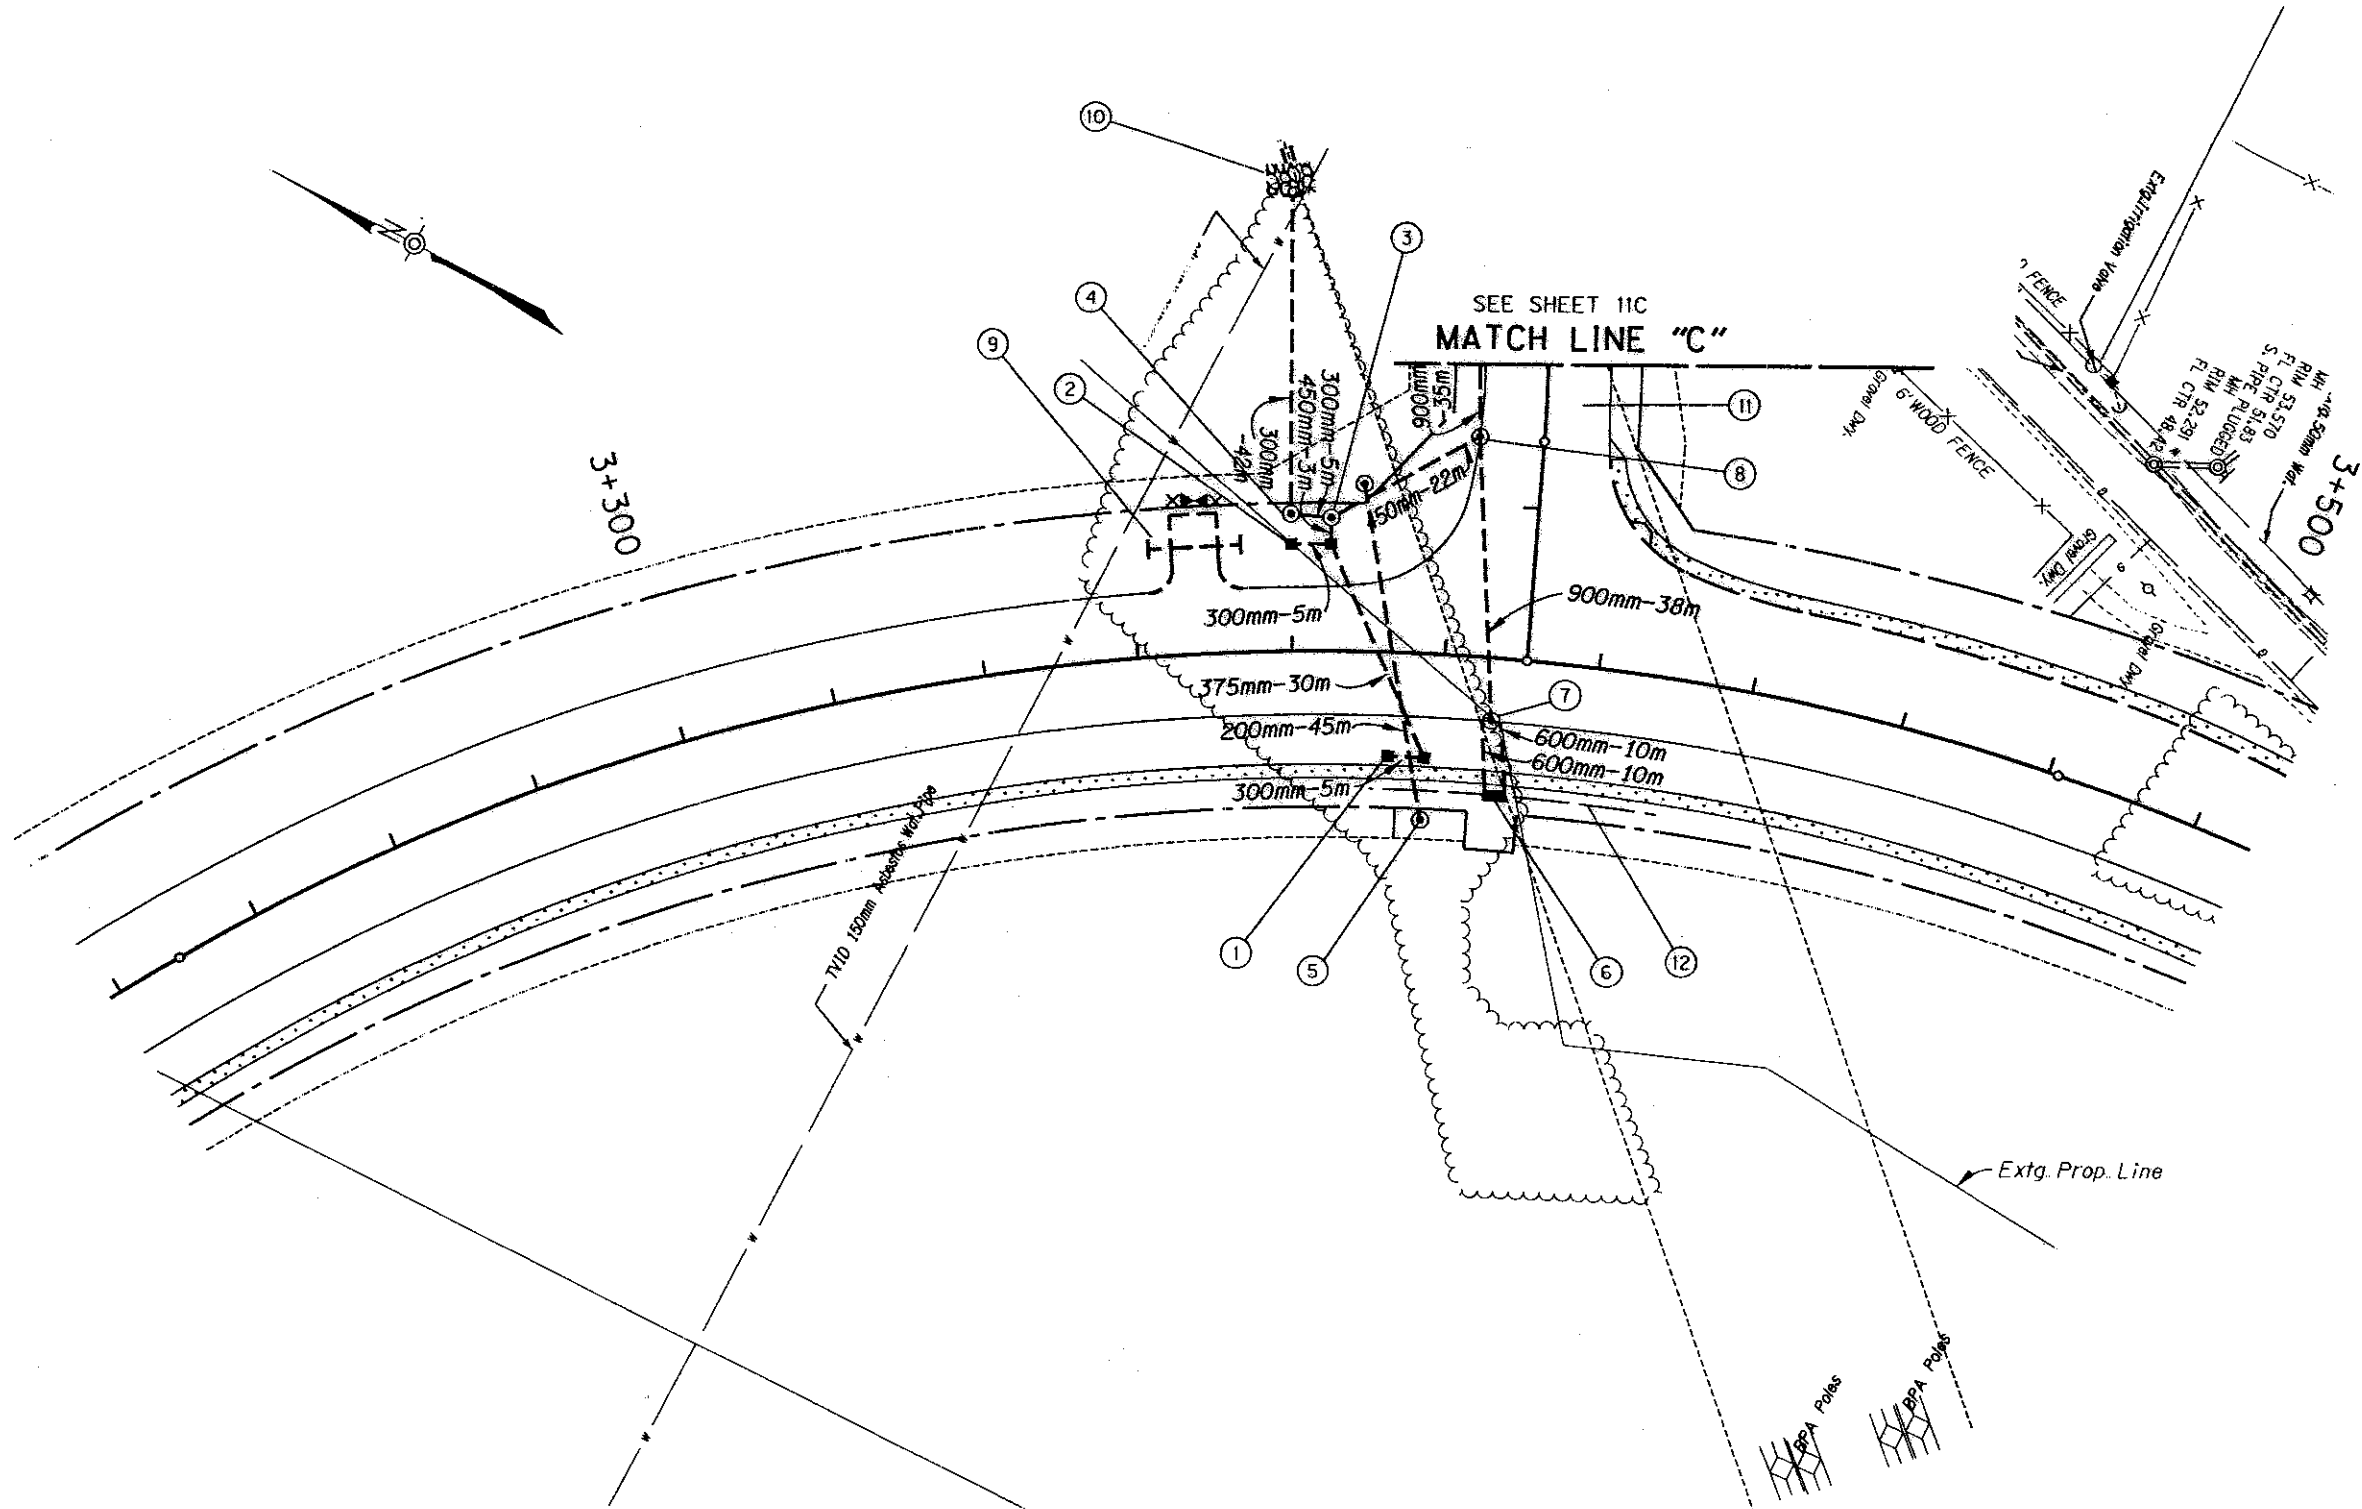

NOTE:
 1. All Dimensions Are Shown In Meters (m)
 Unless Otherwise Noted.



COUNCIL CR.-QUINCE ST. (FOREST GROVE) SEC.
 NEHALEM HWY.
 WASHINGTON COUNTY

FEDERAL HIGHWAY ADMINISTRATION		PROJECT NUMBER	SHEET NO.
REGION 10	OREGON DIVISION	NH-S102 (4)	11A

22 AUG 98

CV2241700436A043541.DWG

VIEW 2



- ① Sta. 3+393 To STA 3+398, 13.765 m Rt.
(Sta. "M" 0+486, 17 m Lt. To 12 m Lt.)
Const. Type "D" Mod. Inlet - 2
Inst. 300 mm Sew. Pipe - 5 m
Inst. 375 mm Sew. Pipe - 30 m
Tr. Exc. - 29 m³
(For Details, See Sht. 2B-7)
(For Pipe Profile, See Sht. 11E)
- ② Sta. 3+380 To STA 3+385, 14.045 m Lt.
(Sta. "M" 0+513.5, 27 m Lt. To 32 m Lt.)
Const. Type "D" Mod. Inlet - 2
Inst. 300 mm Sew. Pipe - 5 m
Inst. 450 mm Sew. Pipe - 3 m
Tr. Exc. - 7 m³
(For Details, See Sht. 2B-7)
(For Pipe Profile, See Sht. 11E)
- ③ Sta. 3+385, 17.5 m Lt.
(Sta. "M" 0+516.5, 27.5 m Lt.)
Const. Type "B-P" Control Manhole
Inst. 300 mm Sew. Pipe - 5 m
Inst. 450 mm Sew. Pipe - 22 m
Tr. Exc. - 26 m³
(For Details, See Sht. 2B-8)
(For Pipe Profile, See Sht. 11E)
- ④ Sta. 3+380, 18 m Lt.
(Sta. "M" 0+517.32 m Lt.)
Const. Water Quality Manhole
Inst. 300 mm Sew. Pipe - 42 m
Const. Outlet Basin
Const. Loose Riprap (Class 50) - 4 m³
Tr. Exc. - 30 m³
(For Details, See Sht. 2B-6 & 2B-9)
- ⑤ Sta. 3+389, 22 m Lt. To STA 3+398, 22 m Rt.
Const. USA Std. Manhole - 2
Inst. 200 mm San. Sew. Pipe - 45 m
Tr. Exc. - 29 m³
(For Profile, See Sht. 15A)
(See USA Std. Drg. No. 010-ST)
- ⑥ Sta. 3+408, 18.2 m Rt.
Const. Double Type "D" Inlet - 2
Inst. 2-600 mm Sew. Pipes - 10 m Ea. - 20 m Total
Tr. Exc. - 34 m³
(For Details, See Sht. 2B-7)
- ⑦ Sta. "M" 0+490.5 m Lt.
Const. Type "A-P" Manhole (2400 mm)
Inst. 900mm Sew. Pipe - 38 m
Tr. Exc. - 148 m³
(See Drg. No. RD327)
- ⑧ Sta. "M" 0+529.8 m Lt.
Const. Type "A-P" Manhole (1800 mm)
Inst. 900 mm Sew. Pipe - 35 m
Tr. Exc. - 136 m³
- ⑨ Sta. 3+368
Inst. 300 mm Culv. Pipe - 12 m
Tr. Exc. - 9 m³
- ⑩ Const. Water Quality Swale No. 7.
(For Details, See Sht. 2B-16)
- ⑪ Relocate BPA Poles
(By Others)
- ⑫ Const. Aggregate Ditch Lining - 60 m²

22 AUG 98

0:\224\F\00436A\0436AF.DWG

10 J 0 1 11A



COUNCIL CR.-QUINCE ST. (FOREST GROVE) SEC.			
NEHALEM HWY.			
WASHINGTON COUNTY			
FEDERAL HIGHWAY ADMINISTRATION	PROJECT NUMBER	SHEET NO.	
REGION 10	OREGON DIVISION	NH-S102 (4)	11A-2

ALIGNMENT & GENERAL CONSTRUCTION

31V-41

Sec. 32, T. 1N, R. 3W, W.M.



- ① STA 0+594 Rt. Const. Appr.
- ② Inst. Single Mailbox Support
Const. Conc. Collar
Inst. Newspaper Box Support
(See Drg. No. RD 100)
- ③ Cold Plane Pavement Removal - 100 m²

SEE SHEET 11
MATCH LINE "C"

22 AUG 98

0:\224\F0436\A0436.dwg

Remove Extg. Surfacing, Shown Thus:

NOTE:
1. All Dimensions Are Shown In Meters (m)
Unless Otherwise Noted.




COUNCIL CR.-QUINCE ST. (FOREST GROVE) SEC.
NEHALEM HWY.
WASHINGTON COUNTY

FEDERAL HIGHWAY ADMINISTRATION		PROJECT NUMBER	SHEET NO.
REGION 10	OREGON DIVISION	NH-S102 (4)	11B

D R A I N A G E & U T I L I T I E S

Sec. 32, T. 1N, R. 3W, W.M.

- ① STA "M" 0+565, 7 m Lt.
Const. Type "A-P" Manhole (1800 mm)
Inst. 900mm Sew. Pipe - 33 m
Tr. Exc - 128.2 m³
- ② STA "M" 0+600, 7m Lt.
Const. Type "B-P" Manhole (2400 mm)
Inst. 2-600mm Sew. Pipes-29m Ea.-58m Total
Tr. Exc - 118 m³
- ③ STA "M" 0+630, 5.5 m Lt.
Const. Type "B-P" Manhole (2400 mm)
Inst. 2-600mm Sew. Pipes-15m Ea.-30 m Total
Const. Outlet Basin
Const. Loose Riprap (Class 100) - 12 m³
Outlet To Creek
Tr. Exc - 61 m³
(For Detail, See Sht. 2B-6)
- ④ STA "M" 0+594, 10.3 m Rt.
Inst. 300 mm Culv. Pipe - 14 m
Tr. Exc - 10 m³
- ⑤ See Sht. 11A, Notes 4 & 10

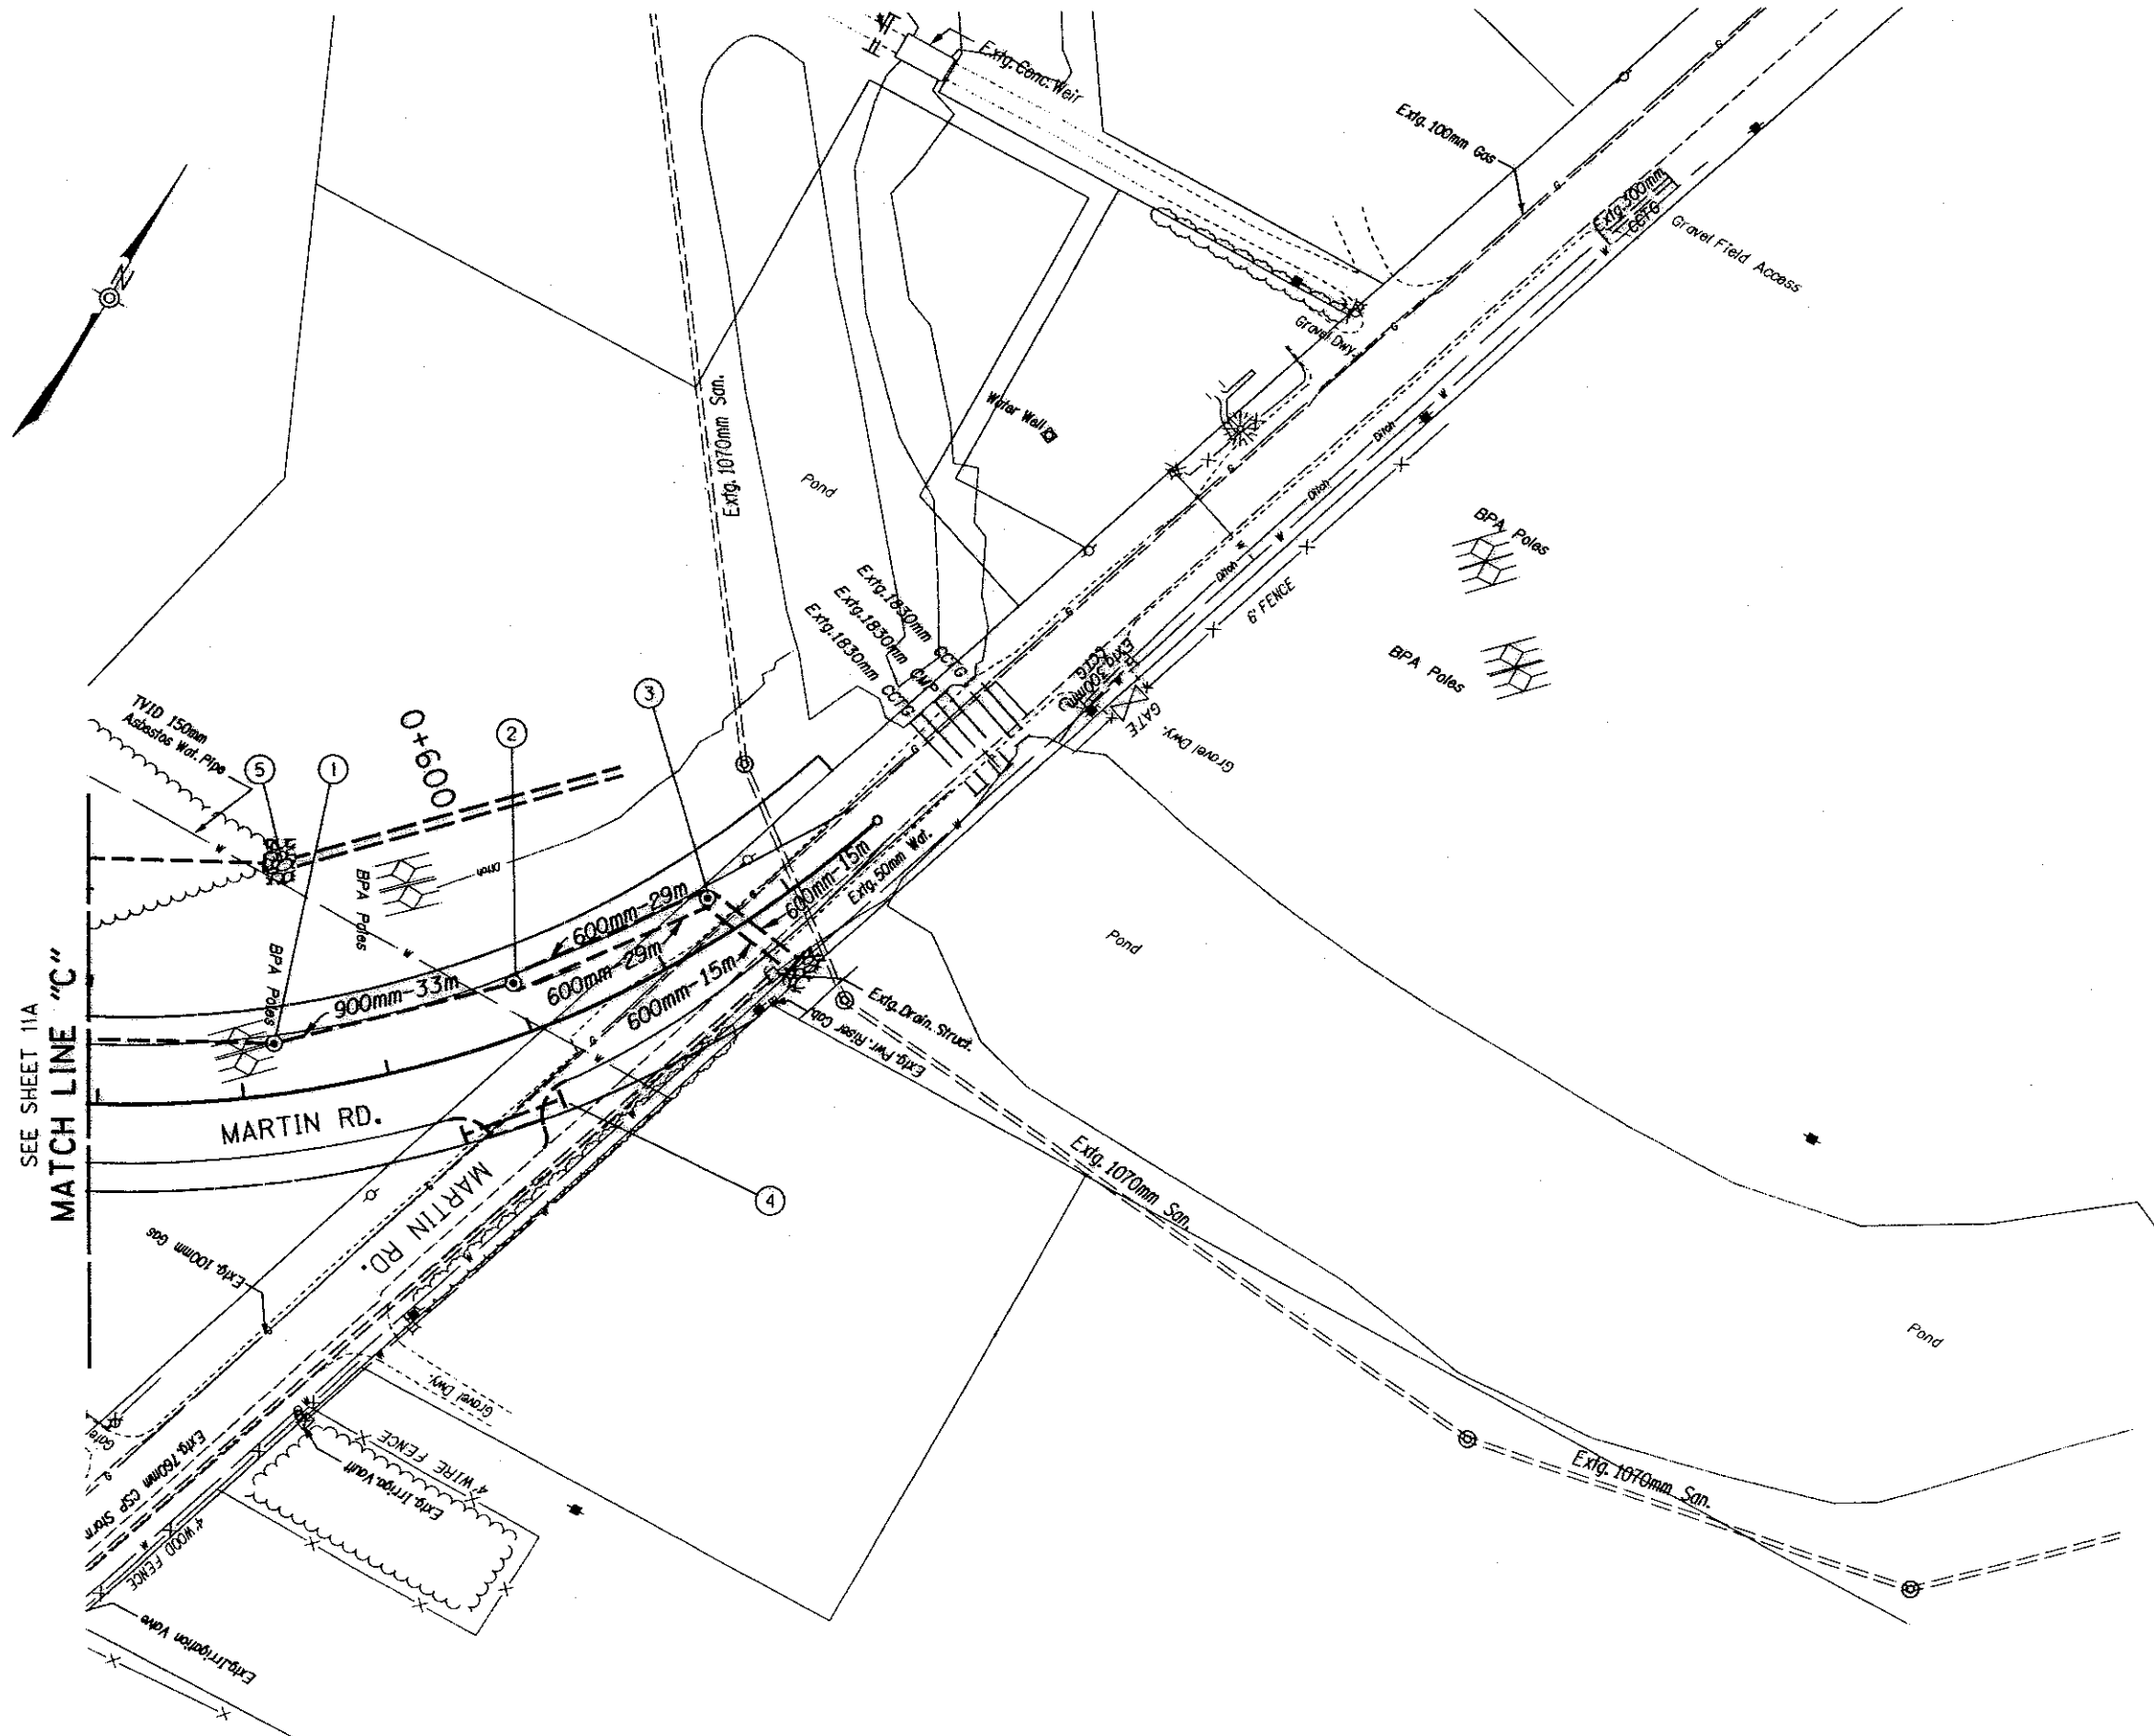

SEE SHEET 11A
MATCH LINE "C"

NOTE:
1. All Dimensions Are Shown In Meters (m)
Unless Otherwise Noted.




COUNCIL CR.-QUINCE ST. (FOREST GROVE) SEC.
NEHALEM HWY.
WASHINGTON COUNTY

FEDERAL HIGHWAY ADMINISTRATION		PROJECT NUMBER	SHEET NO.
REGION 10	OREGON DIVISION	NH-S102 (4)	11C

22 AUG 98

0-122411-003640-03641-015

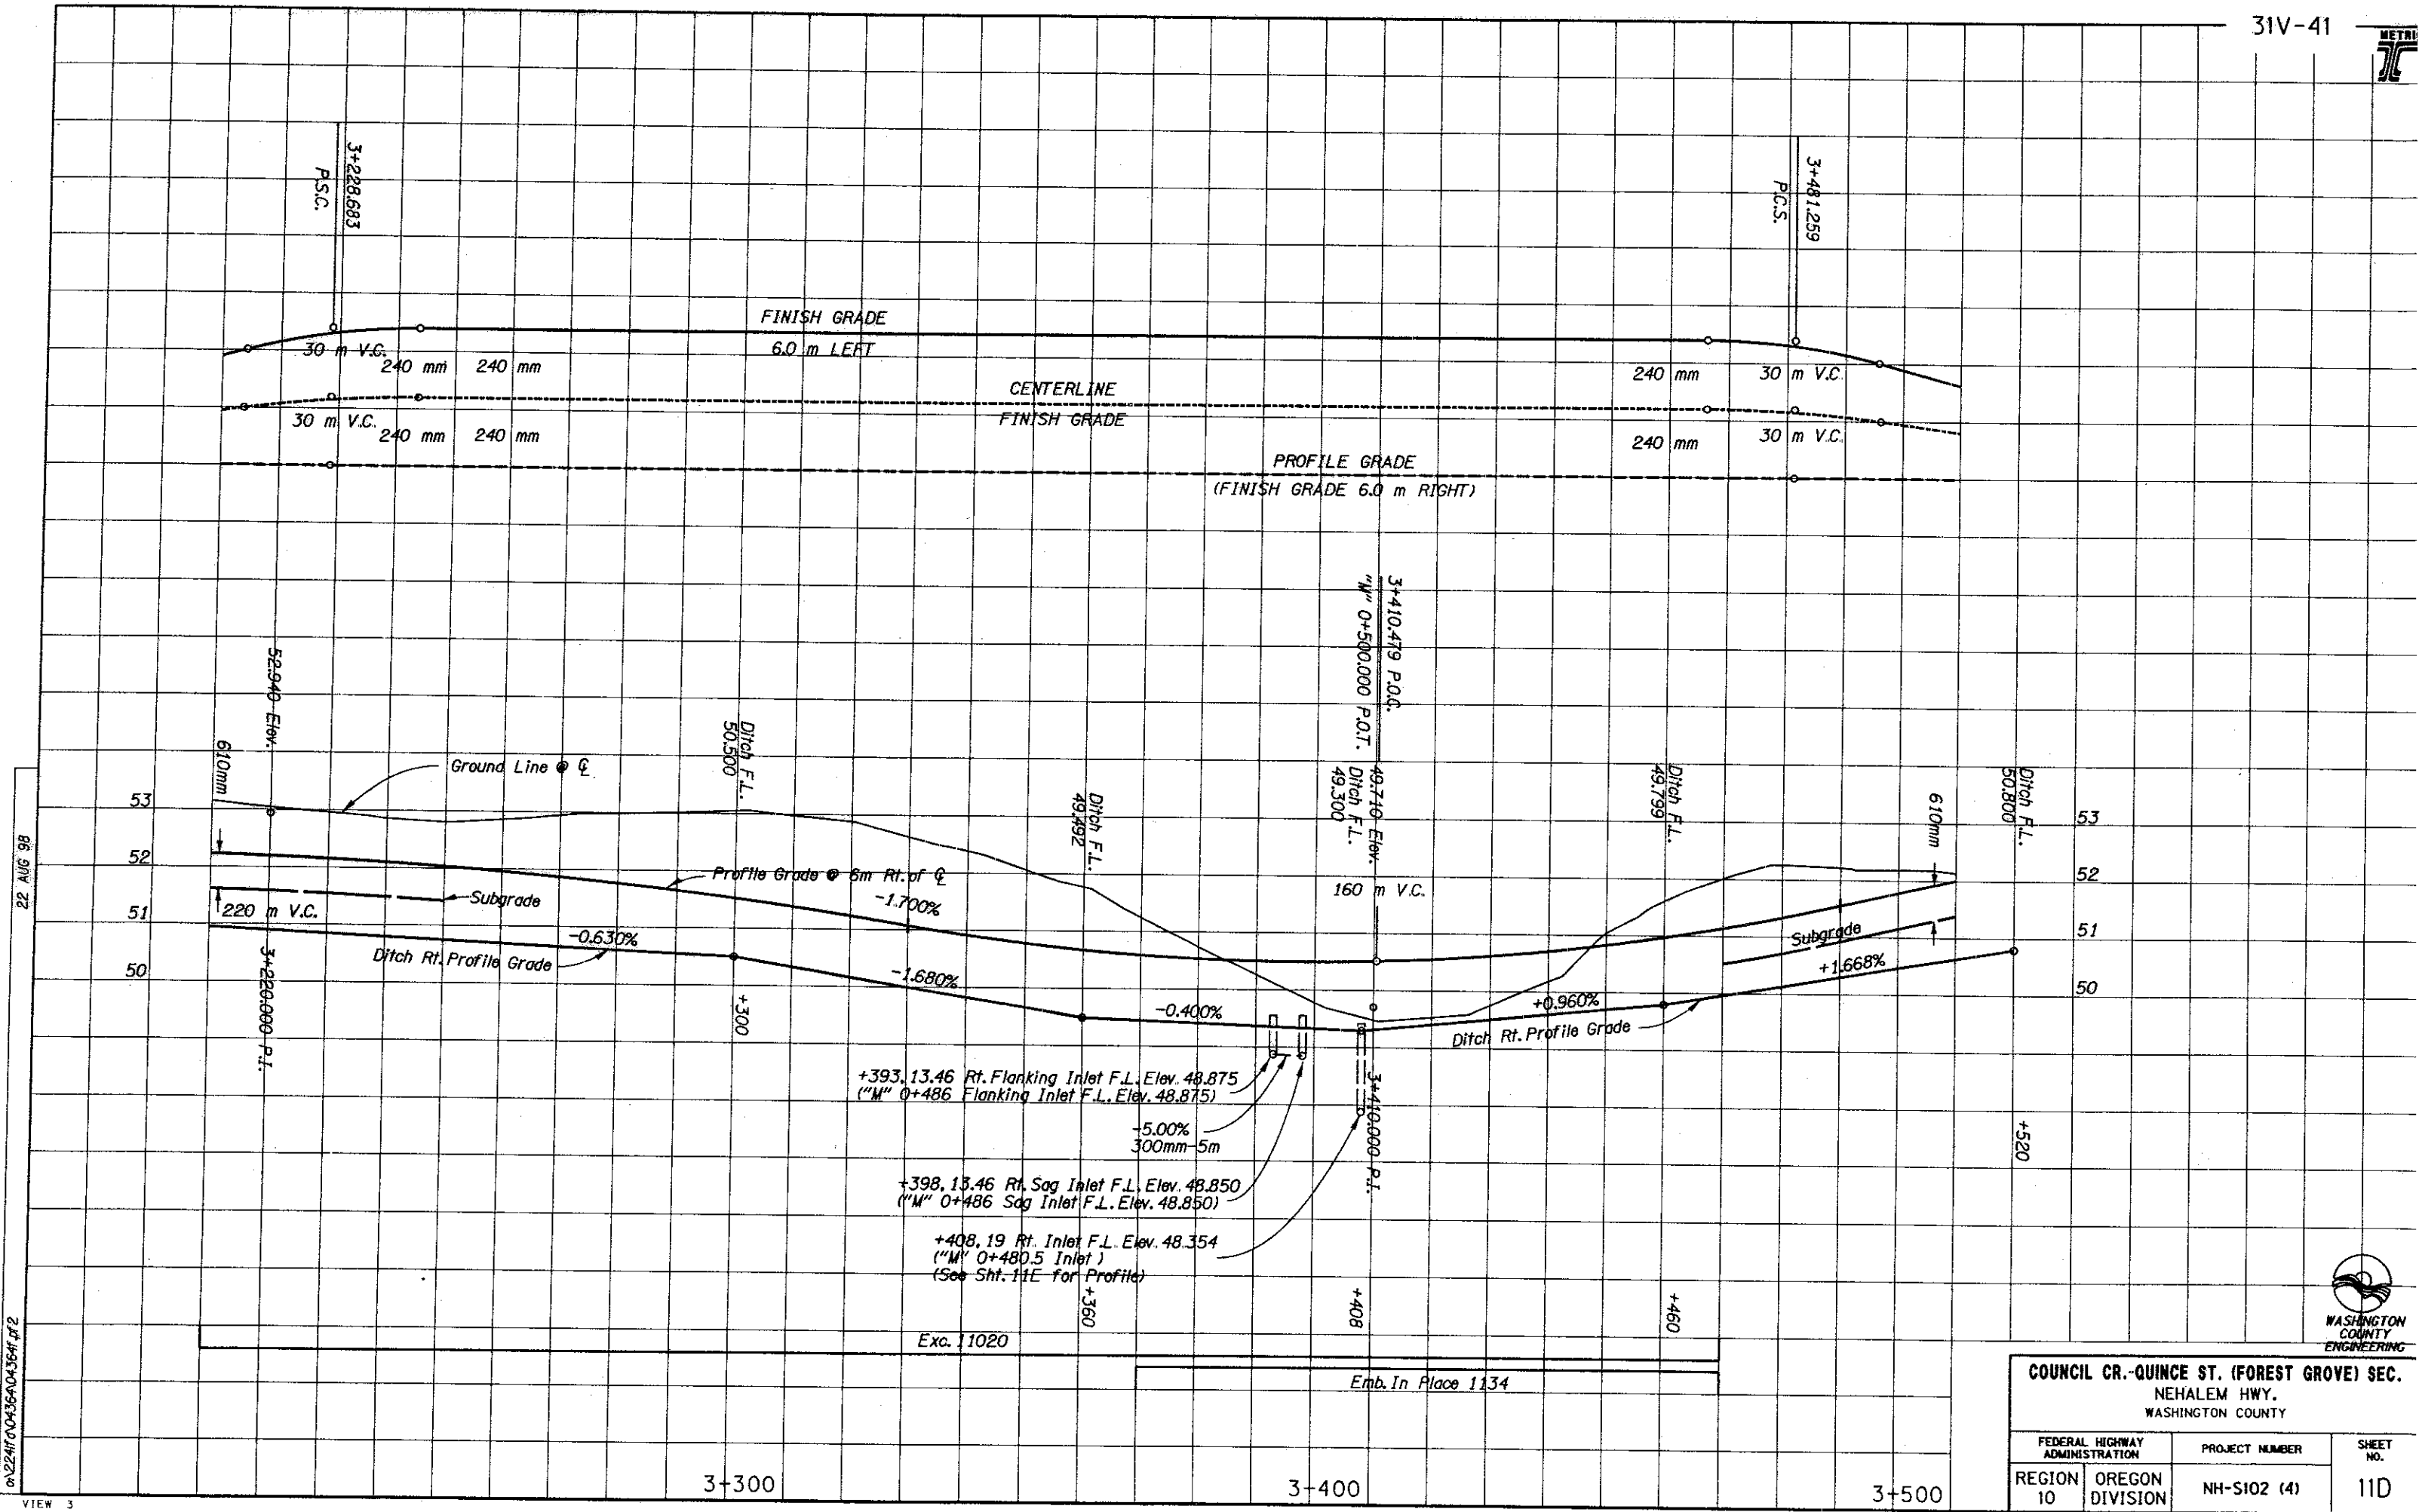

22 AUG 98

0422410436404364.dwg



VIEW 3



COUNCIL CR.-QUINCE ST. (FOREST GROVE) SEC.			
NEHALEM HWY.			
WASHINGTON COUNTY			
FEDERAL HIGHWAY ADMINISTRATION	PROJECT NUMBER	SHEET NO.	
REGION 10	OREGON DIVISION	NH-S102 (4)	11D



"M" LINE
STORM SEWER PROFILE @ LEFT SIDE

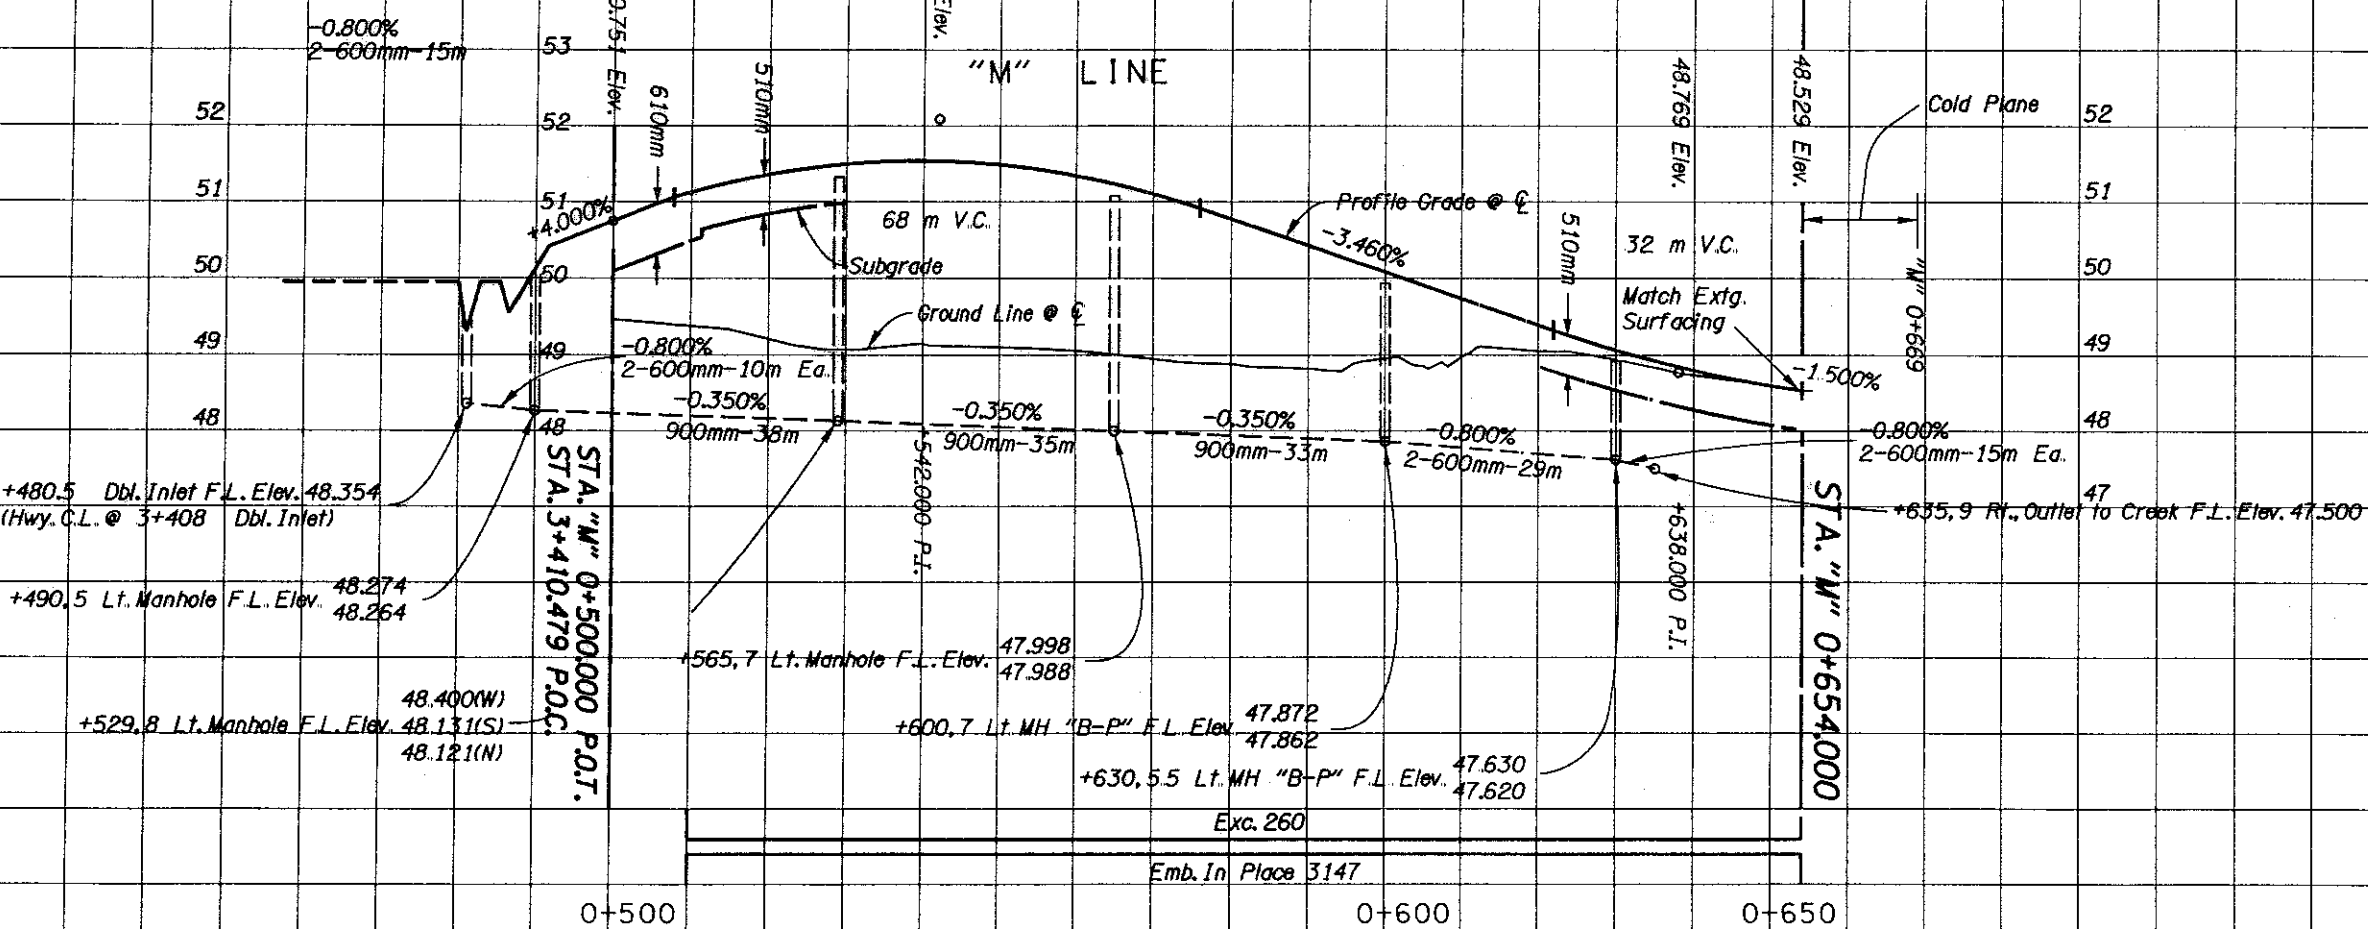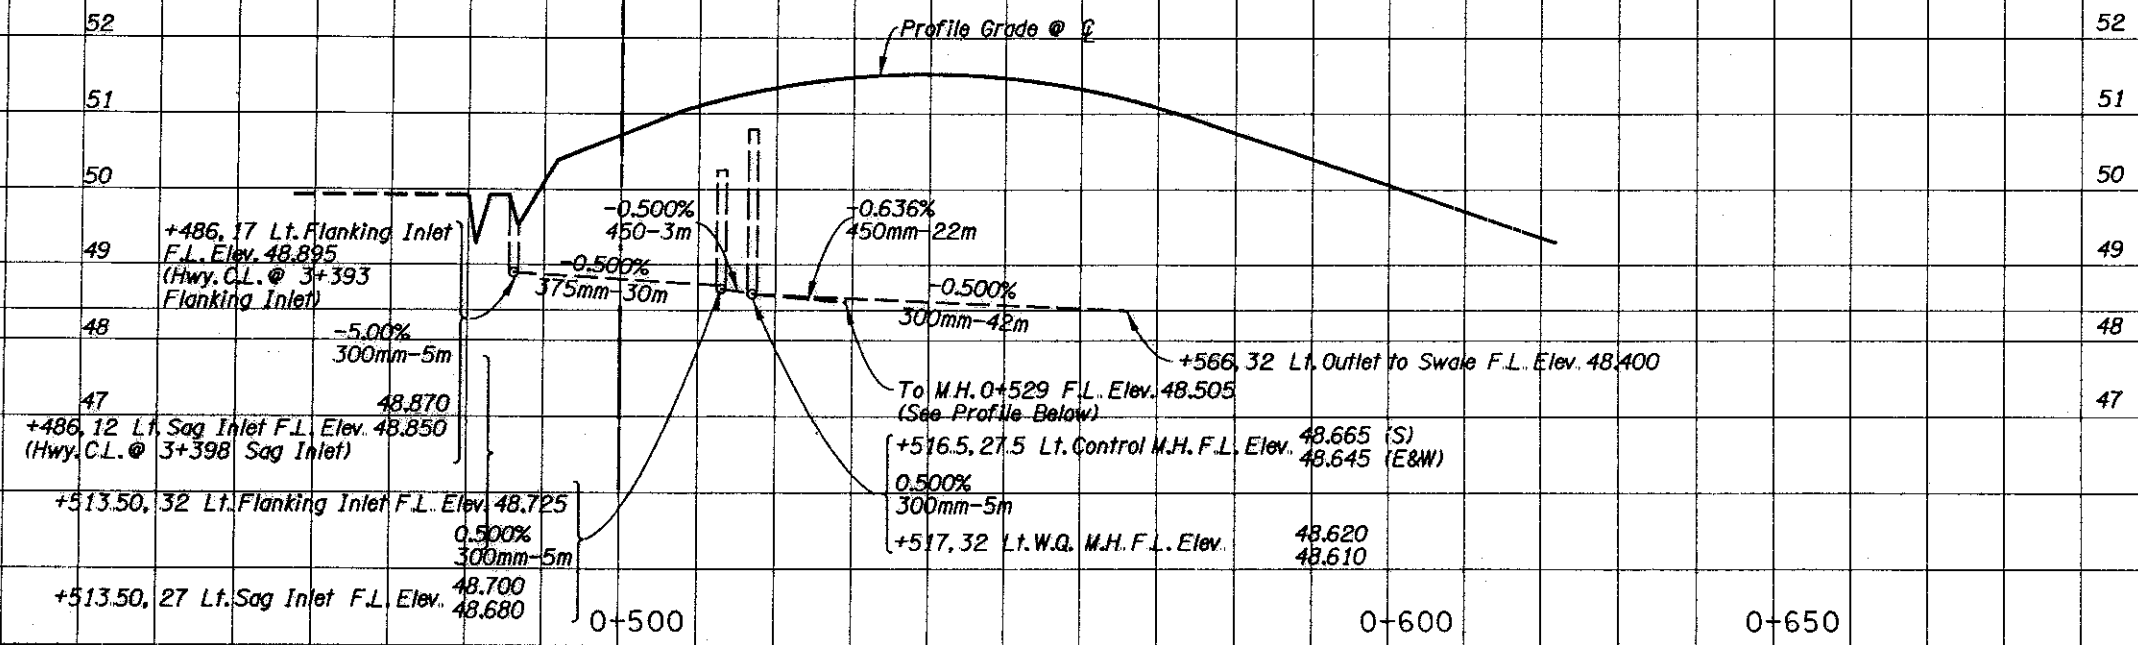

22 AUG 98

02241 0036A0364 of 3



COUNCIL CR.-QUINCE ST. (FOREST GROVE) SEC.
NEHALEM HWY.
WASHINGTON COUNTY

FEDERAL HIGHWAY ADMINISTRATION		PROJECT NUMBER	SHEET NO.
REGION 10	OREGON DIVISION	NH-S102 (4)	11E




PRECAST MANHOLE TYPE A-P

NOTES:
For Cast-in-Place Manhole see Drg. No. RD324.
For Cover and Frame details see Drg. No. RD324.
300 mm min. wall is required between pipes in manhole.


All dimensions are in mm unless otherwise noted.

SHALLOW PRECAST MANHOLE TYPE B-P


NOTE: See Manhole type A-P for details not shown.

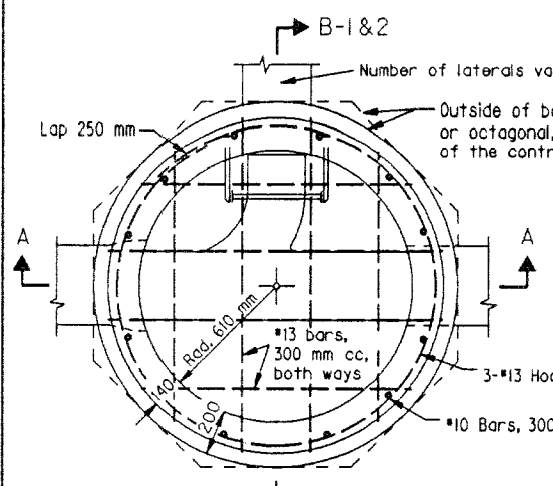

PLAN OF BASE (Base, Risers & Cone)

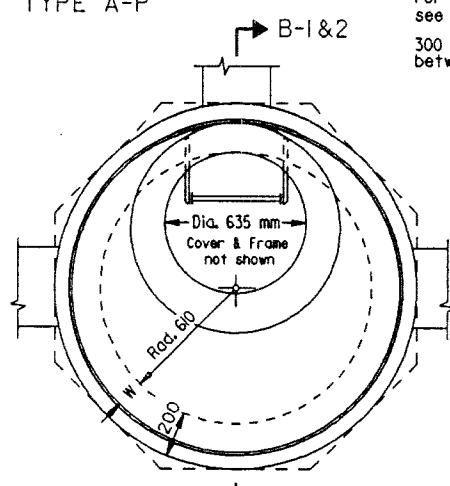

TOP VIEW (Base, Risers & Cone)

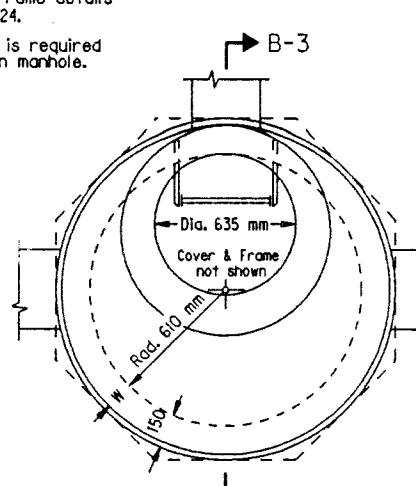

TOP VIEW (Base & Cone)


ALTERNATE JOINT

MINIMUM DEPTH OF MANHOLE TYPE A-P


ØD(mm)	H(mm)
200	1675
250	1750
300	1825
375	1900
450	1975
525	2050
600	2125

ØD is inside diameter of the largest pipe entering or leaving base.


NOTE: When depth is less than minimum for manhole type A-P, use shallow manhole type B or type B-P.

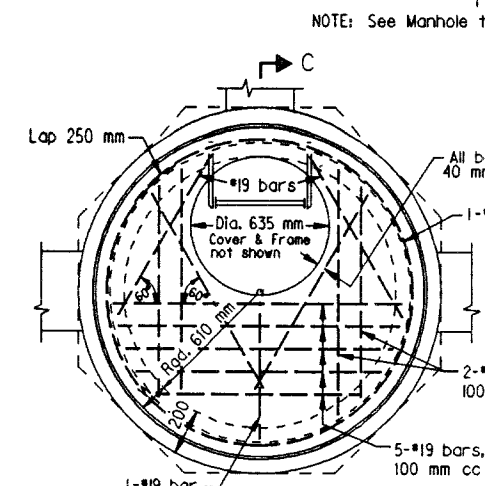


TOP VIEW (Base, Riser & Cover Slab)

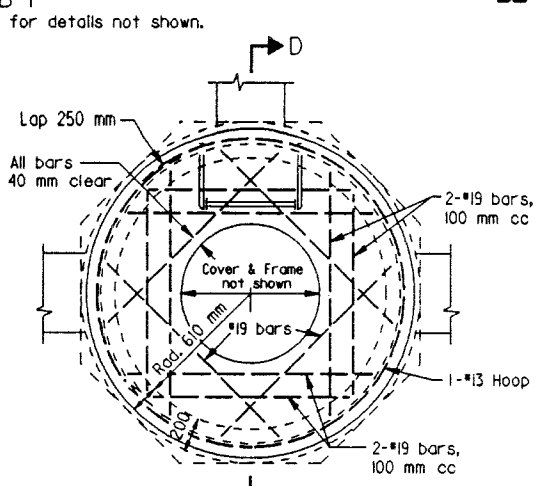

TOP VIEW (Base & Cover Slab)

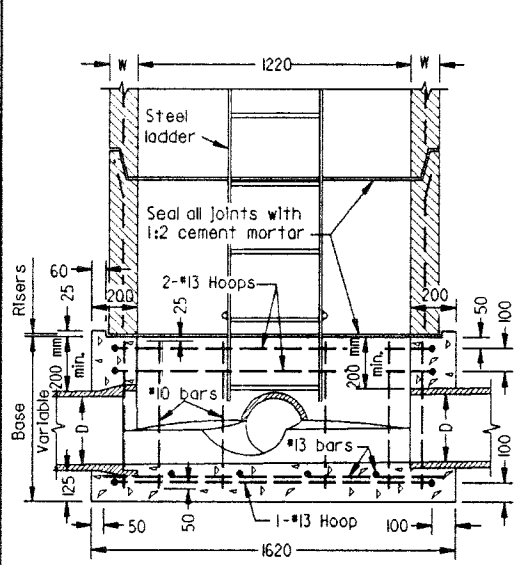


PARTIAL SECTION A-A (Base, Risers & Cone)

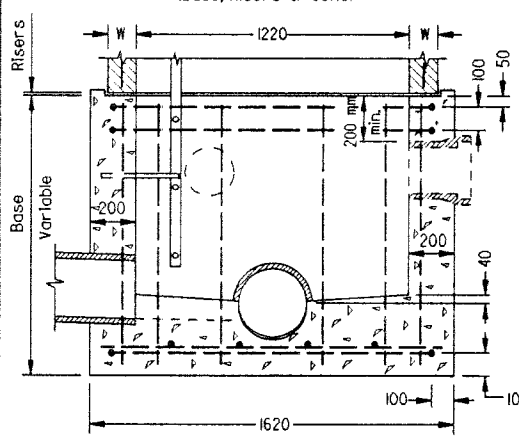


SECTION B-B-2 (Base for Manholes)

NOTE: Set pipes for catch basin connections in base, to grade and directions furnished by the engineer.

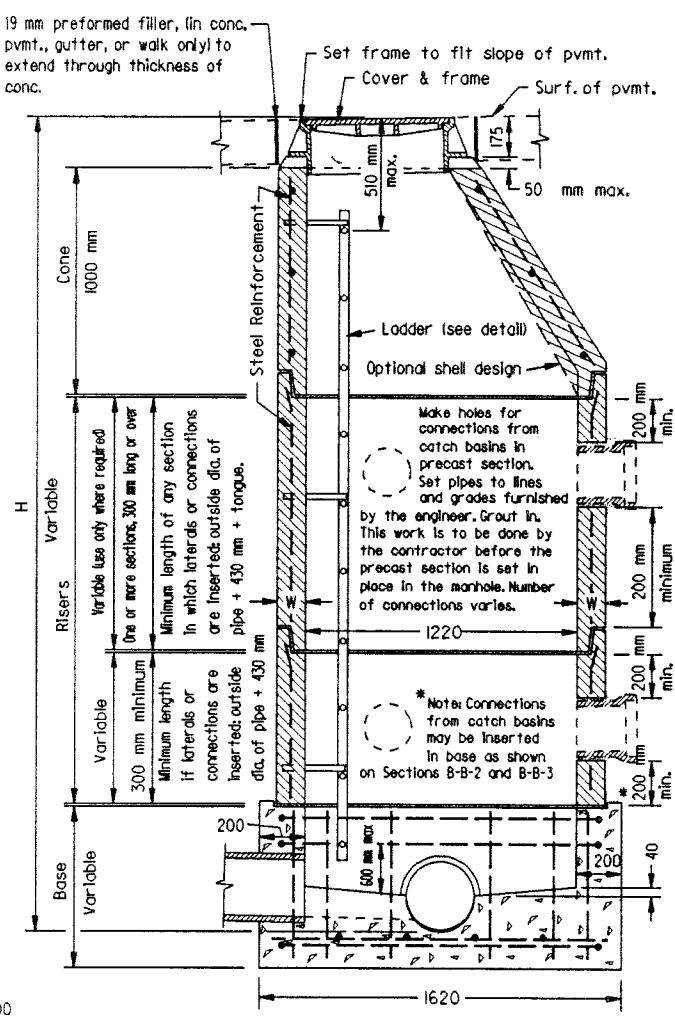


SECTION B-B-1 (Base, Risers & Cone)

NOTE: Use Section B-B-3 when length of risers become less than minimum shown.

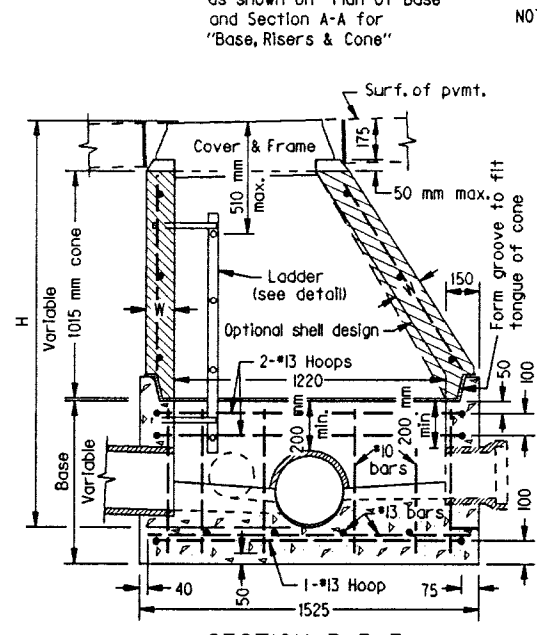


SECTION B-B-3 (Base & Cone)

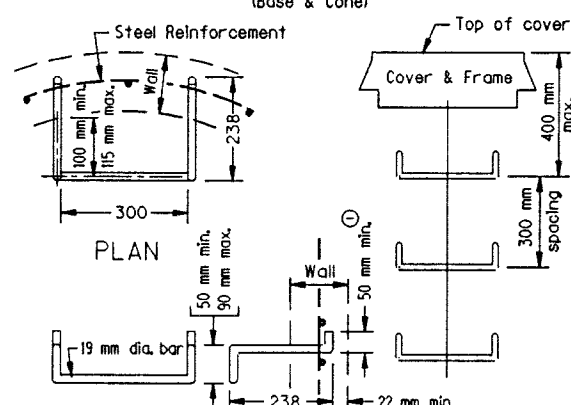


FRONT SIDE STEPS (Steps may be substituted for ladder)

See Current Qualified Products List (QPL) For Acceptable Alternate Manhole Steps

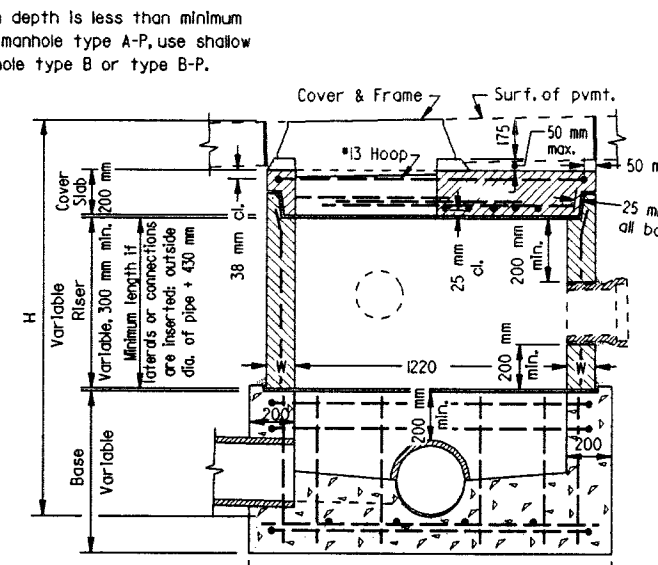

SECTION C-C (Base, Riser & Cover Slab)

NOTE: Use Section D-D when length of riser becomes less than minimum shown.

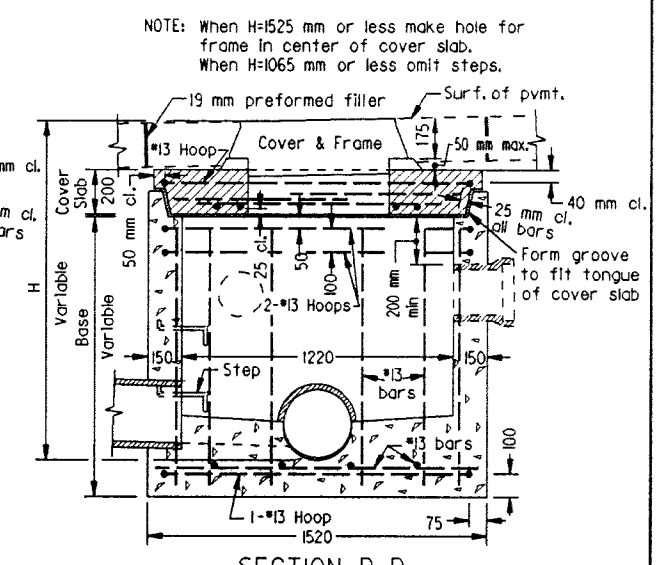

SECTION D-D (Base & Cover Slab)

NOTE: The risers, cones and cover slabs shall meet the requirements of the current AASHTO Standard Specification M199M

LEGEND

- Cast-in-Place concrete
- Precast concrete
- 1:2 cement mortar
- Sewer pipe
- W 100 mm min. (For tolerance see AASHTO M199M)

NOTE: All material and workmanship shall be in accordance with the current State of Oregon Standard Specifications for Highway Construction.

OREGON DEPARTMENT OF TRANSPORTATION STANDARD

MANHOLES

JANUARY 1996

DATE	REVISIONS DESCRIPTION	APPROVED
8-96	REVISED REINFORCEMENT	<i>San Johnston</i> STANDARDS ENGINEER
4-97	REVISED STEPS DETAIL	

DRG. NO. RD327

nt7360a/rd327.met

RD327

Hook may be eliminated, provided steps will withstand a "pull" force of 450 kg without loosening.

DETAIL OF STEEL LADDER See Steps