

# OPERATION & MAINTENANCE MANUAL

DFI No. : D00673

Facility Type: Bio-Retention Pond



[April, 2018]

**INDEX**

1. IDENTIFICATION ..... 1

2. FACILITY CONTACT INFORMATION ..... 1

3. CONSTRUCTION ..... 1

4. STORM DRAIN SYSTEM AND FACILITY OVERVIEW ..... 1

5. FACILITY HAZ MAT SPILL FEATURE(S).....4

6. AUXILIARY OUTLET (HIGH FLOW BYPASS) ..... 4

7. MAINTENANCE REQUIREMENTS ..... 5

8. WASTE MATERIAL HANDLING ..... 5

APPENDIX A: Operational Plan and Profile Drawing

APPENDIX B: ODOT Project Plan Sheets

## 1. Identification

Drainage Facility ID (DFI): **D00673**  
Facility Type: Bio-Retention Pond  
Construction Drawings: (V-File Number) 46V-022  
Location: District: 2B  
Highway No.: 64  
Mile Post: (13.40 to 13.45) Hwy 64  
Description: This facility is located north of the off ramp from southbound I-205 to the Sunrise Corridor.

## 2. Facility Contact Information

Contact the Engineer of Record, Region Technical Center, or Geo-Environmental's Senior Hydraulics Engineer for:

- Operational clarification
- Maintenance clarification
- Repair or restoration assistance

### Engineering Contacts:

Region Technical Center Hydro Unit Manager

Or

Geo-Environmental Senior Hydraulics Engineer (503) 986-3365.

## 3. Construction

Engineer of Record: Consultant Designer – [OBEC Consulting Engineers, Amy Jones, 971-634-2005]

Facility construction: [2014]

Contractor: Kerr Contractors, Inc.

## 4. Storm Drain System and Facility Overview

A bio-retention pond is a basin that is designed to capture the water quality design volume and filter out the pollutants by filtering the runoff through the water quality mix constructed in the pond bottom. The

filtration process removes a variety of pollutants through physical, biological and chemical treatment mechanisms. The water in the facility exits through an under drain pipe below the water quality mix. The outlet control structure limits the rate of runoff leaving the pond by using an orifice. These facilities are designed to infiltrate the water quality design storm volume within 36 hours. The sizing of these facilities depends on the location and the amount of contributing impervious area.

This bio-retention pond is designed to store runoff during wet weather and is dry the remainder of the time. It is located north of the off ramp from southbound I-205 to the Sunrise Corridor. Access to the facility is provided with an access road connecting to the ramp shoulder.

There is one culvert that conveys stormwater runoff from paved areas along the off ramp into the detention pond. The locations of this is noted on the Operation Plan as point A in Appendix A

Runoff exits the pond by way of a Type "D" inlet and 12-inch storm drain pipe that connects to a manhole containing the flow control assembly. See Points B and C on the Operational Plan in Appendix A.

The storm drain outlet pipe from the flow control manhole connects to the auxiliary outfall. The storm drain pipe from the auxiliary outfall is 12-inches in diameter and connects to a manhole connecting to the flow control manhole. These are shown in the Operational Plan in Appendix A. The receiving waterway for the outlet pipes is Dean Creek.

A. Maintenance equipment access:

The pond and outlet structures can be accessed from the ramp shoulder and from a maintenance access road connecting to the ramp shoulder. See the road layout on the Operational Plan in Appendix A.

B. Heavy equipment access into facility:

- Allowed (no limitations)
- Allowed (with limitations)
- Not allowed

C. Special Features:

- Amended Soils
- Porous Pavers
- Liners
- Underdrains

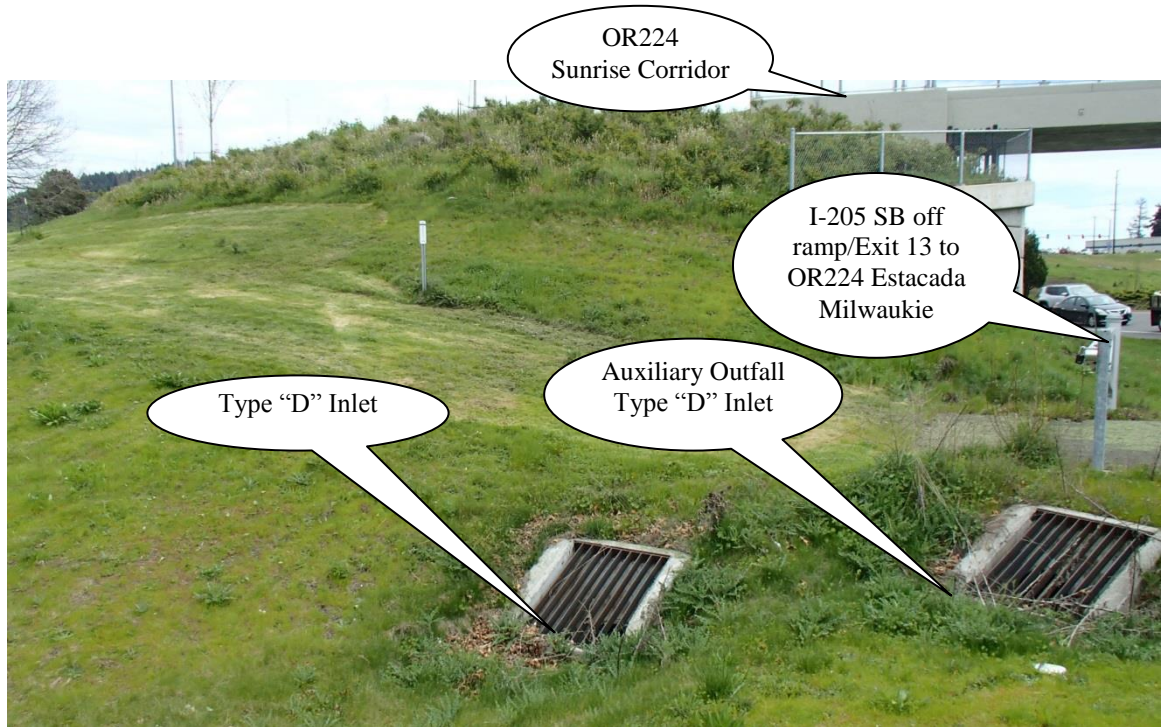


Photo 1: a view of bio-retention pond, looking Southeast at the inlets.



Photo 2: a view of bio-retention pond, looking Northeast at storm drain pipe outlet.

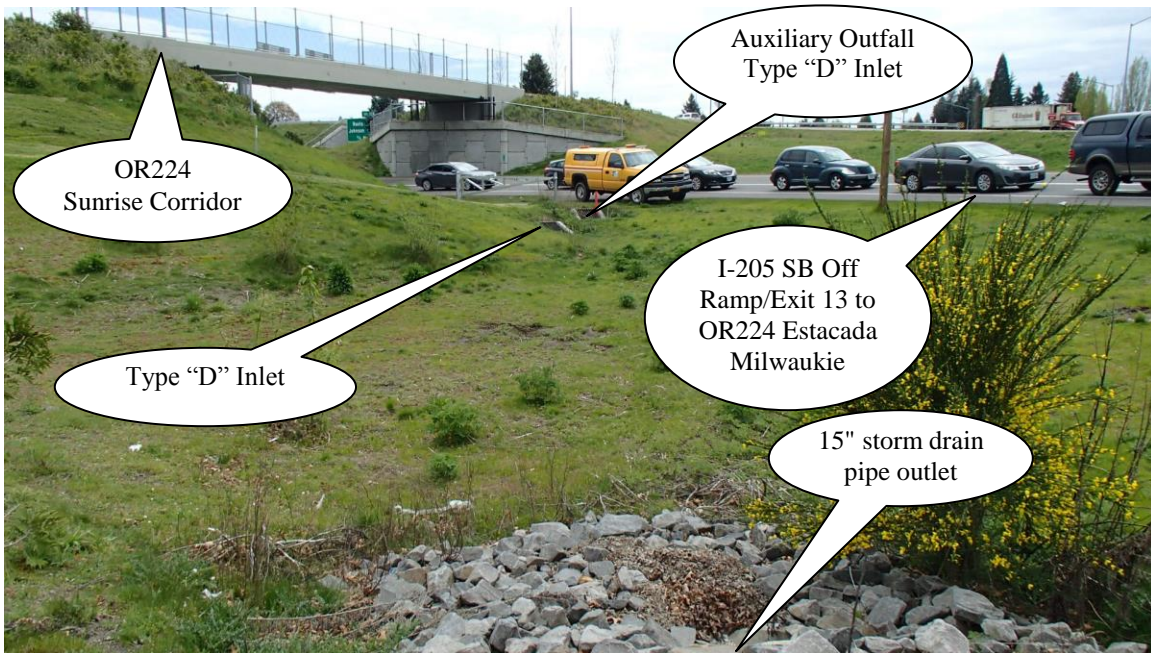


Photo 3: a view of bio-retention pond, looking South toward I-205 off ramp.

## 5. Facility Haz Mat Spill Feature(s)

The pond can be used to store a volume of liquid by blocking the 12-inch diameter outlet pipe with the Type “D” inlet located at the outfall structure on the south side of the pond. This is noted as point B in the Operational Plan. A barrier such as a metal plate over the metal grate on the inlet could be used to prevent liquid from draining from the pond.

## 6. Auxiliary Outlet (High Flow Bypass)

Auxiliary Outlets are provided if the primary outlet control structure cannot safely pass the projected high flows. Broad-crested spillway weirs and over flow risers are the two most common auxiliary outlets used in stormwater facility design. The auxiliary outlet feature is either a part of the facility or an additional storm drain feature/structure.

The auxiliary outlet feature for this facility is:

- Designed into facility  
High flows exit the pond through the auxiliary outlet structure consisting of a “D” inlet. This inlet connects to the outfall pipe from the main outfall and flow control structure. See Photo 1 and Points B and D in the Operational Plan in Appendix A.
- Other, as noted below

There is an underdrain pipe system designed to provide infiltration for the pond.

## 7. Maintenance Requirements

Routine maintenance table for non-proprietary stormwater treatment and storage/detention facilities have been incorporated into ODOT's Maintenance Guide. These tables summarize the maintenance requirements for ponds, swales, filter strips, bioslopes, and detention tanks and vaults. Special maintenance requirements in addition to the routine requirements are noted below when applicable.

The ODOT Maintenance Guide can be viewed at the following website:

<http://www.oregon.gov/ODOT/HWY/OOM/MGuide.shtml>

The following stormwater facility maintenance table (See ODOT Maintenance Guide) should be used to maintain the facility outlined in this Operation and Maintenance Manual:

- Table 1 (general maintenance)
- Table 2 (stormwater ponds)
- Table 3 (water quality biofiltration swales)
- Table 4 (water quality filter strips)
- Table 5 (water quality bioslopes)
- Table 6 (detention tank)
- Table 7 (detention vault)
- Appendix C (proprietary structure)
- Special Maintenance requirements

## 8. Waste Material Handling

Material removed from the facility is defined as waste by DEQ. Refer to the roadwaste section of the ODOT Maintenance Yard Environmental Management System (EMS) Policy and Procedures Manual for disposal options: <http://egov.oregon.gov/ODOT/HWY/OOM/EMS.shtml>

Contact any of the following for more detailed information about management of waste materials found on site:

ODOT Clean Water Unit	(503) 986-3008
ODOT Statewide Hazmat Coordinator	(503) 229-5129
ODOT Region Hazmat Coordinator	(503) 731-8290
ODEQ Northwest Region Office	(503) 229-5263




















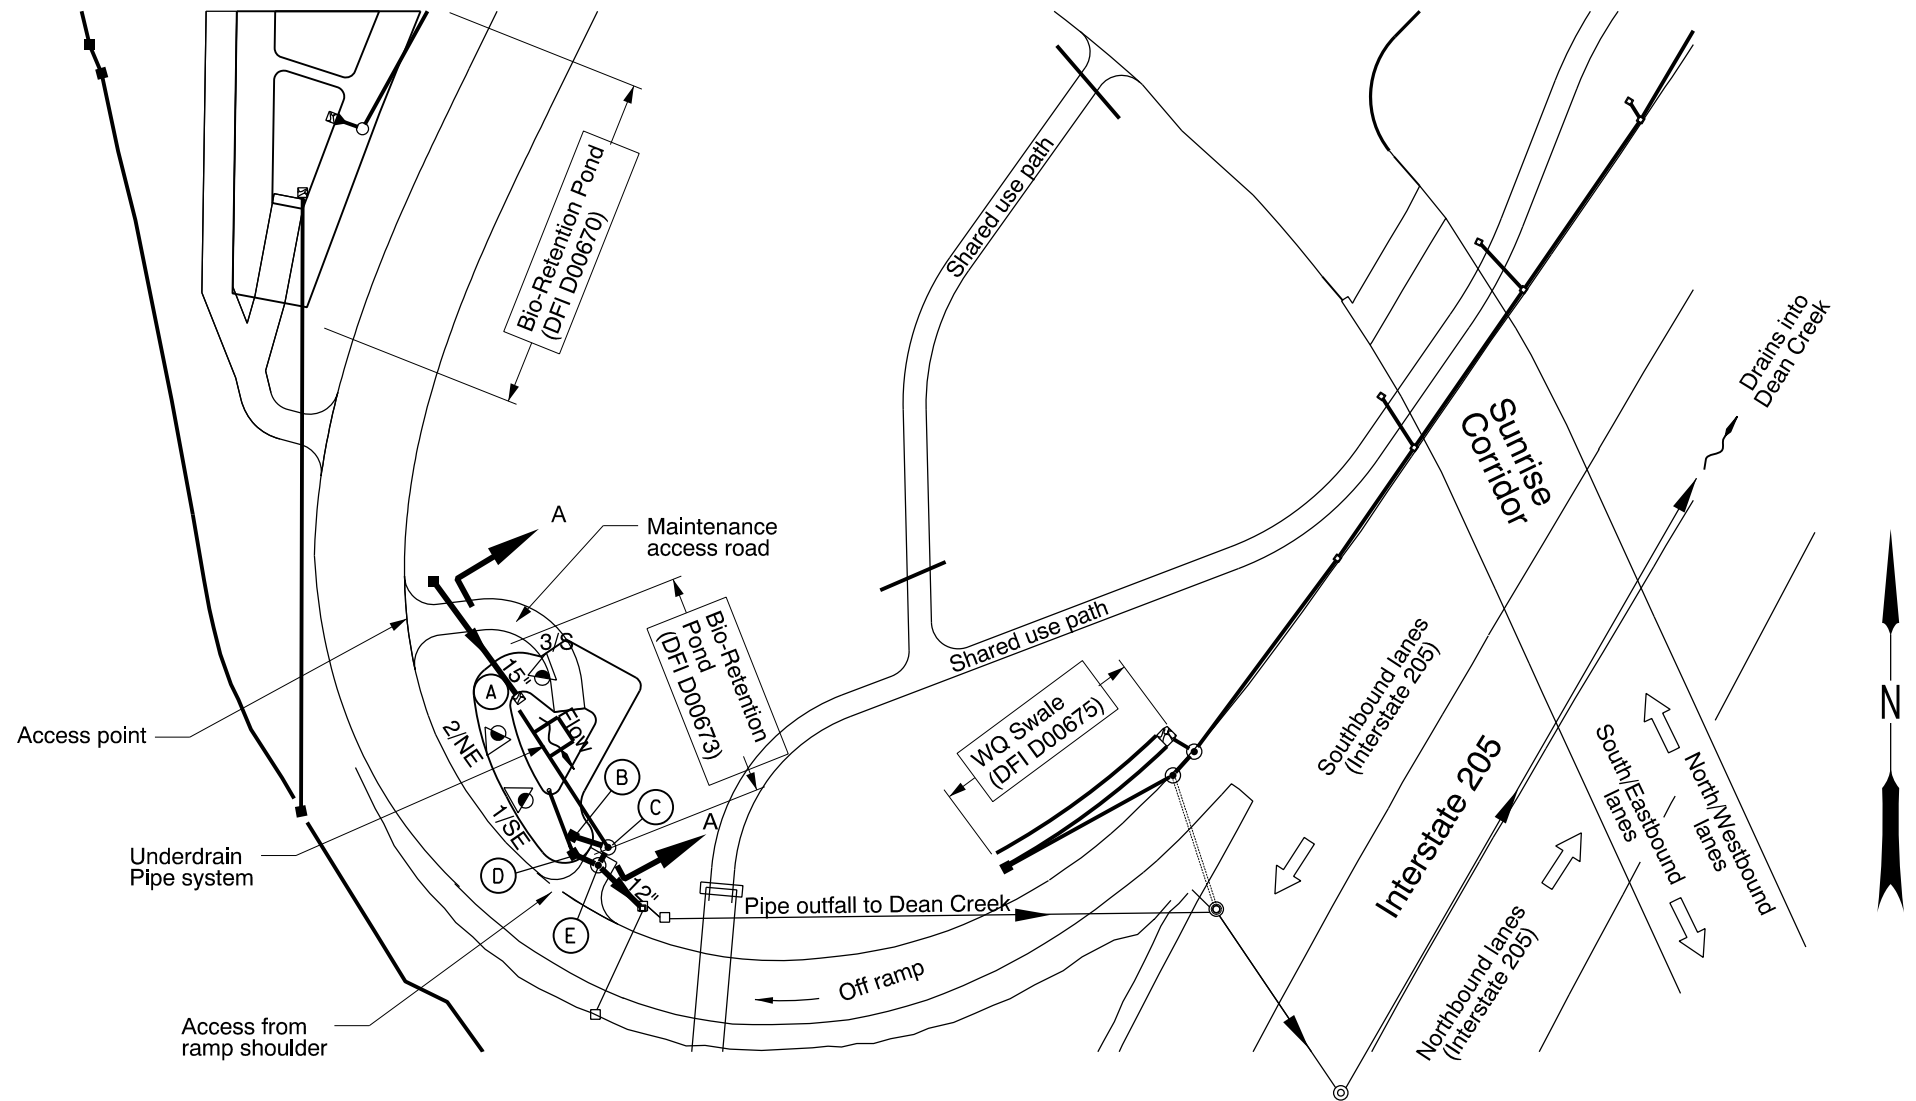
## **Appendix A**

### **Content:**


- **Operational Plan and Profile Drawing**

**LEGEND:**

-  Photo Location / Direction
-  15" storm drain pipe outlet
-  Type "D" Inlet and 12" storm drain pipe outfall
-  Flow control manhole
-  Auxiliary outfall - Type "D" Inlet and 12" storm drain pipe outfall
-  Storm drain manhole
-  and  Manhole
-  and  Inlet
-  Storm Pipe (Facility)
-  Storm Pipe (Not connected to facility)
-  Storm Pipe (Existing)
-  Conveyance Direction
-  Pavement / Facility Flow Path



**PLAN**  
N.T.S.

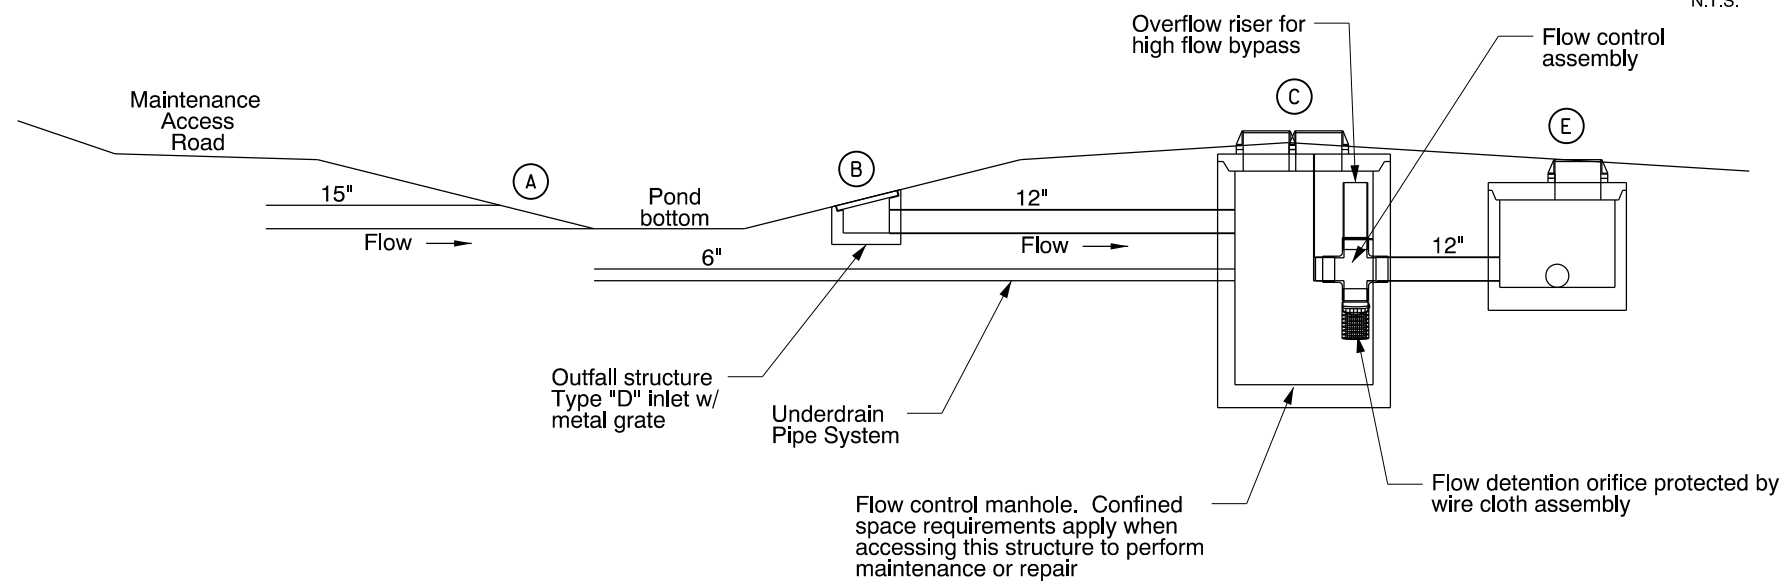

**SECTION A-A**  
N.T.S.

 OREGON DEPARTMENT OF TRANSPORTATION

Prepared By: Amy Jones  
 Drafted By: Amy Jones


**DFI D00673**  
**MAINTENANCE DISTRICT 2B HWY 64**  
**BIO-RETENTION POND**  
 EAST PORTLAND FWY MP 13.4 TO MP 13.45  
 CLACKAMAS COUNTY

# Appendix B

## Content:

- **ODOT Project Plan Sheets**
  - *Cover/Title Sheet*
  - *Water Quality/Detention Plan Sheets*
  - *Other Details*

STATE OF OREGON  
 DEPARTMENT OF TRANSPORTATION  
 PLANS FOR PROPOSED PROJECT  
**GRADING, DRAINAGE, STRUCTURES, PAVING, SIGNING,  
 ILLUMINATION, SIGNALS & ROADSIDE DEVELOPMENT**

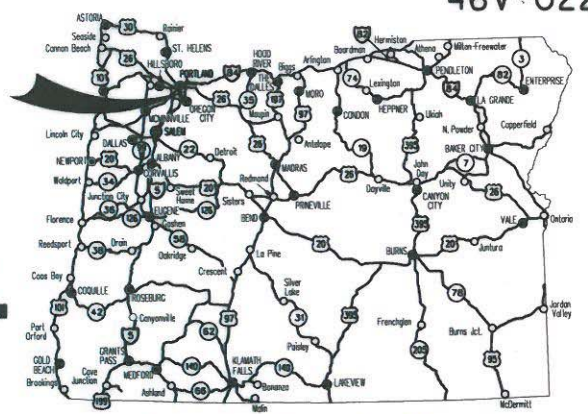

Overall Length Of Project - 3.90 Miles

INDEX OF SHEETS	
SHEET NO.	DESCRIPTION
1	Title Sheet
1A	Index Of Sheets Cont'd.

**FFO - OR212/224: SUNRISE CORRIDOR (I-205 - SE 122ND AVE) SEC.  
 CLACKAMAS HWY.  
 CLACKAMAS COUNTY  
 MARCH 2013**

**ATTENTION:**  
 Oregon Law Requires You To Follow Rules Adopted By The Oregon Utility Notification Center. Those Rules Are Set Forth In OAR 952-001-0010 Through OAR 952-001-0090. You May Obtain Copies Of The Rules By Calling The Center. (Note: The Telephone Number For The Oregon Utility Center is (503) 232-1987.)

**LET'S ALL  
 WORK TOGETHER  
 TO MAKE THIS  
 JOB SAFE**


**BEGIN WORK  
 JTA-STP-S171(030)  
 STA. "SR1" 505+78**

**BEGIN WORK  
 JTA-STP-S171(030)  
 STA. "G" 463+00**

**END WORK  
 JTA-STP-S171(030)  
 STA. "G" 492+00**

**END WORK  
 JTA-STP-S171(030)  
 STA. "OR" 352+20**

**END WORK  
 JTA-STP-S171(030)  
 STA. "T" 705+75**

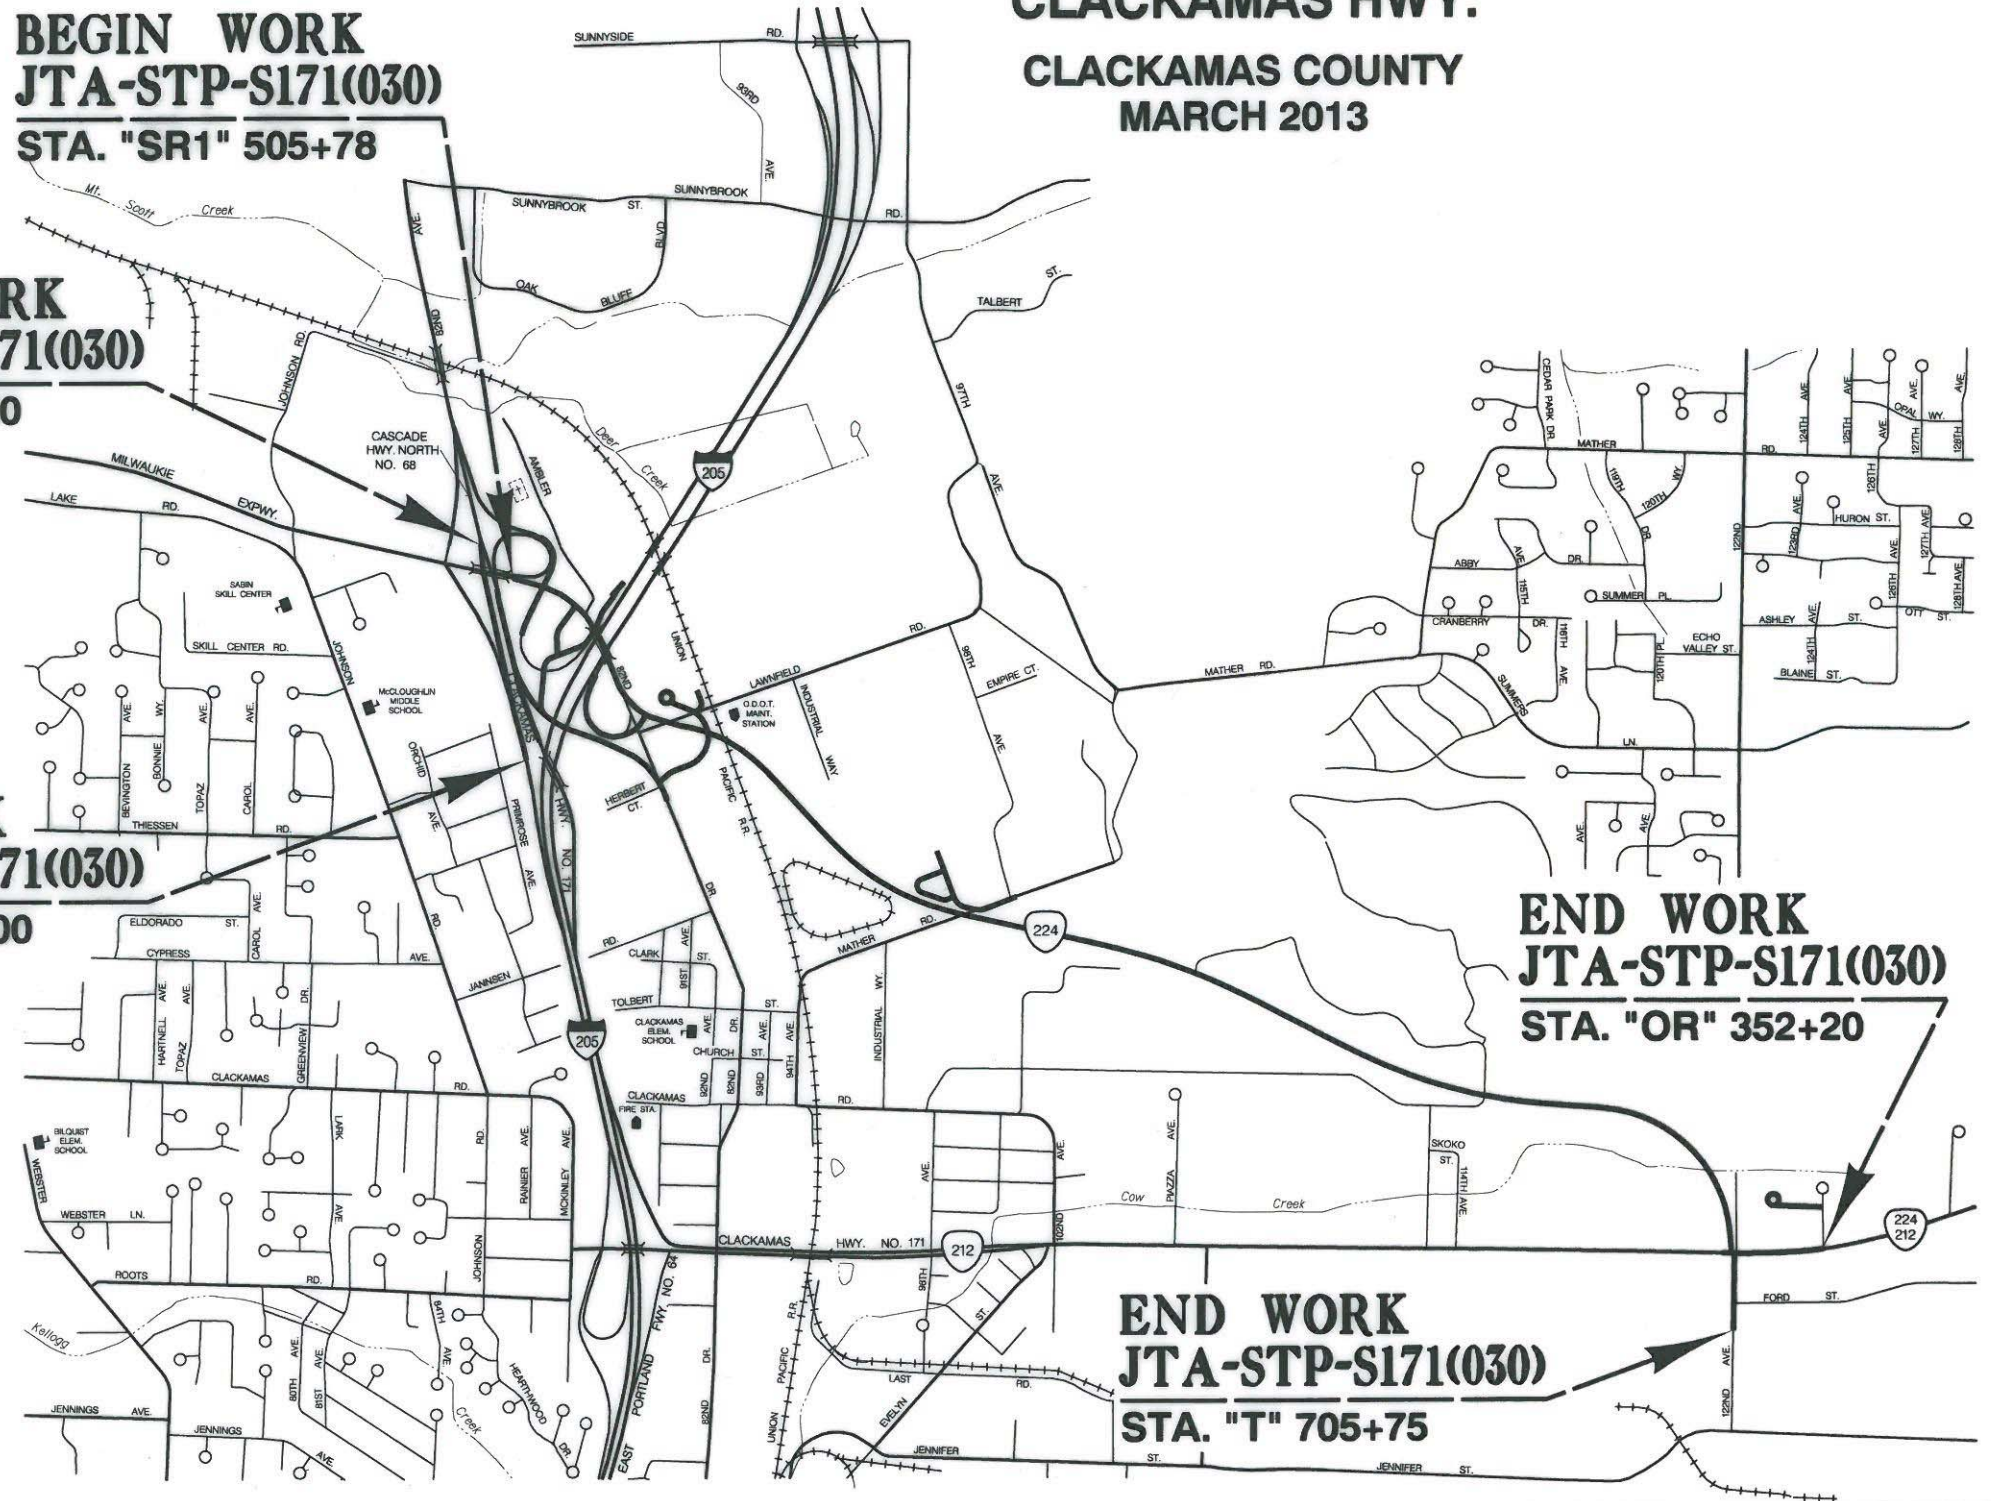

SEC. 4, 5, 9, 10, 11  
 T. 2 S., R. 2 E., W.M.

**OREGON TRANSPORTATION COMMISSION**  
 Pat Egan CHAIR  
 David Lohman COMMISSIONER  
 Mary F. Olson COMMISSIONER  
 Mark Frohnmayer COMMISSIONER  
 Tammy Boney COMMISSIONER  
 Matthew L. Garrett DIRECTOR OF TRANSPORTATION

PLANS PREPARED FOR  
 OREGON DEPARTMENT OF TRANSPORTATION


**OBEC CONSULTING ENGINEERS**  
 CORPORATE OFFICE: 920 COUNTRY CLUB ROAD, SUITE 100B EUGENE, OREGON 97401-0089  
 REGIONAL OFFICES: LAKE OSWEGO, SALEM, MEDFORD, OREGON; VANCOUVER, WASHINGTON

These plans were developed using ODOT design standards. Exceptions to these standards, if any, have been submitted and approved by the ODOT Chief Engineer or their delegated authority.

Approving Authority: *Lawrence H. Fox* 12/31/12  
 Signature & date  
**LAWRENCE H. FOX - PROJECT MANAGER**  
 Print name and title  
 Concurrence by ODOT Chief Engineer

**FFO - OR212/224: SUNRISE CORRIDOR (I-205 - SE 122ND AVE) SEC.  
 CLACKAMAS HWY.  
 CLACKAMAS COUNTY**

FEDERAL HIGHWAY ADMINISTRATION	PROJECT NUMBER	SHEET NO.
OREGON DIVISION	JTA-STP-S171(030)	1

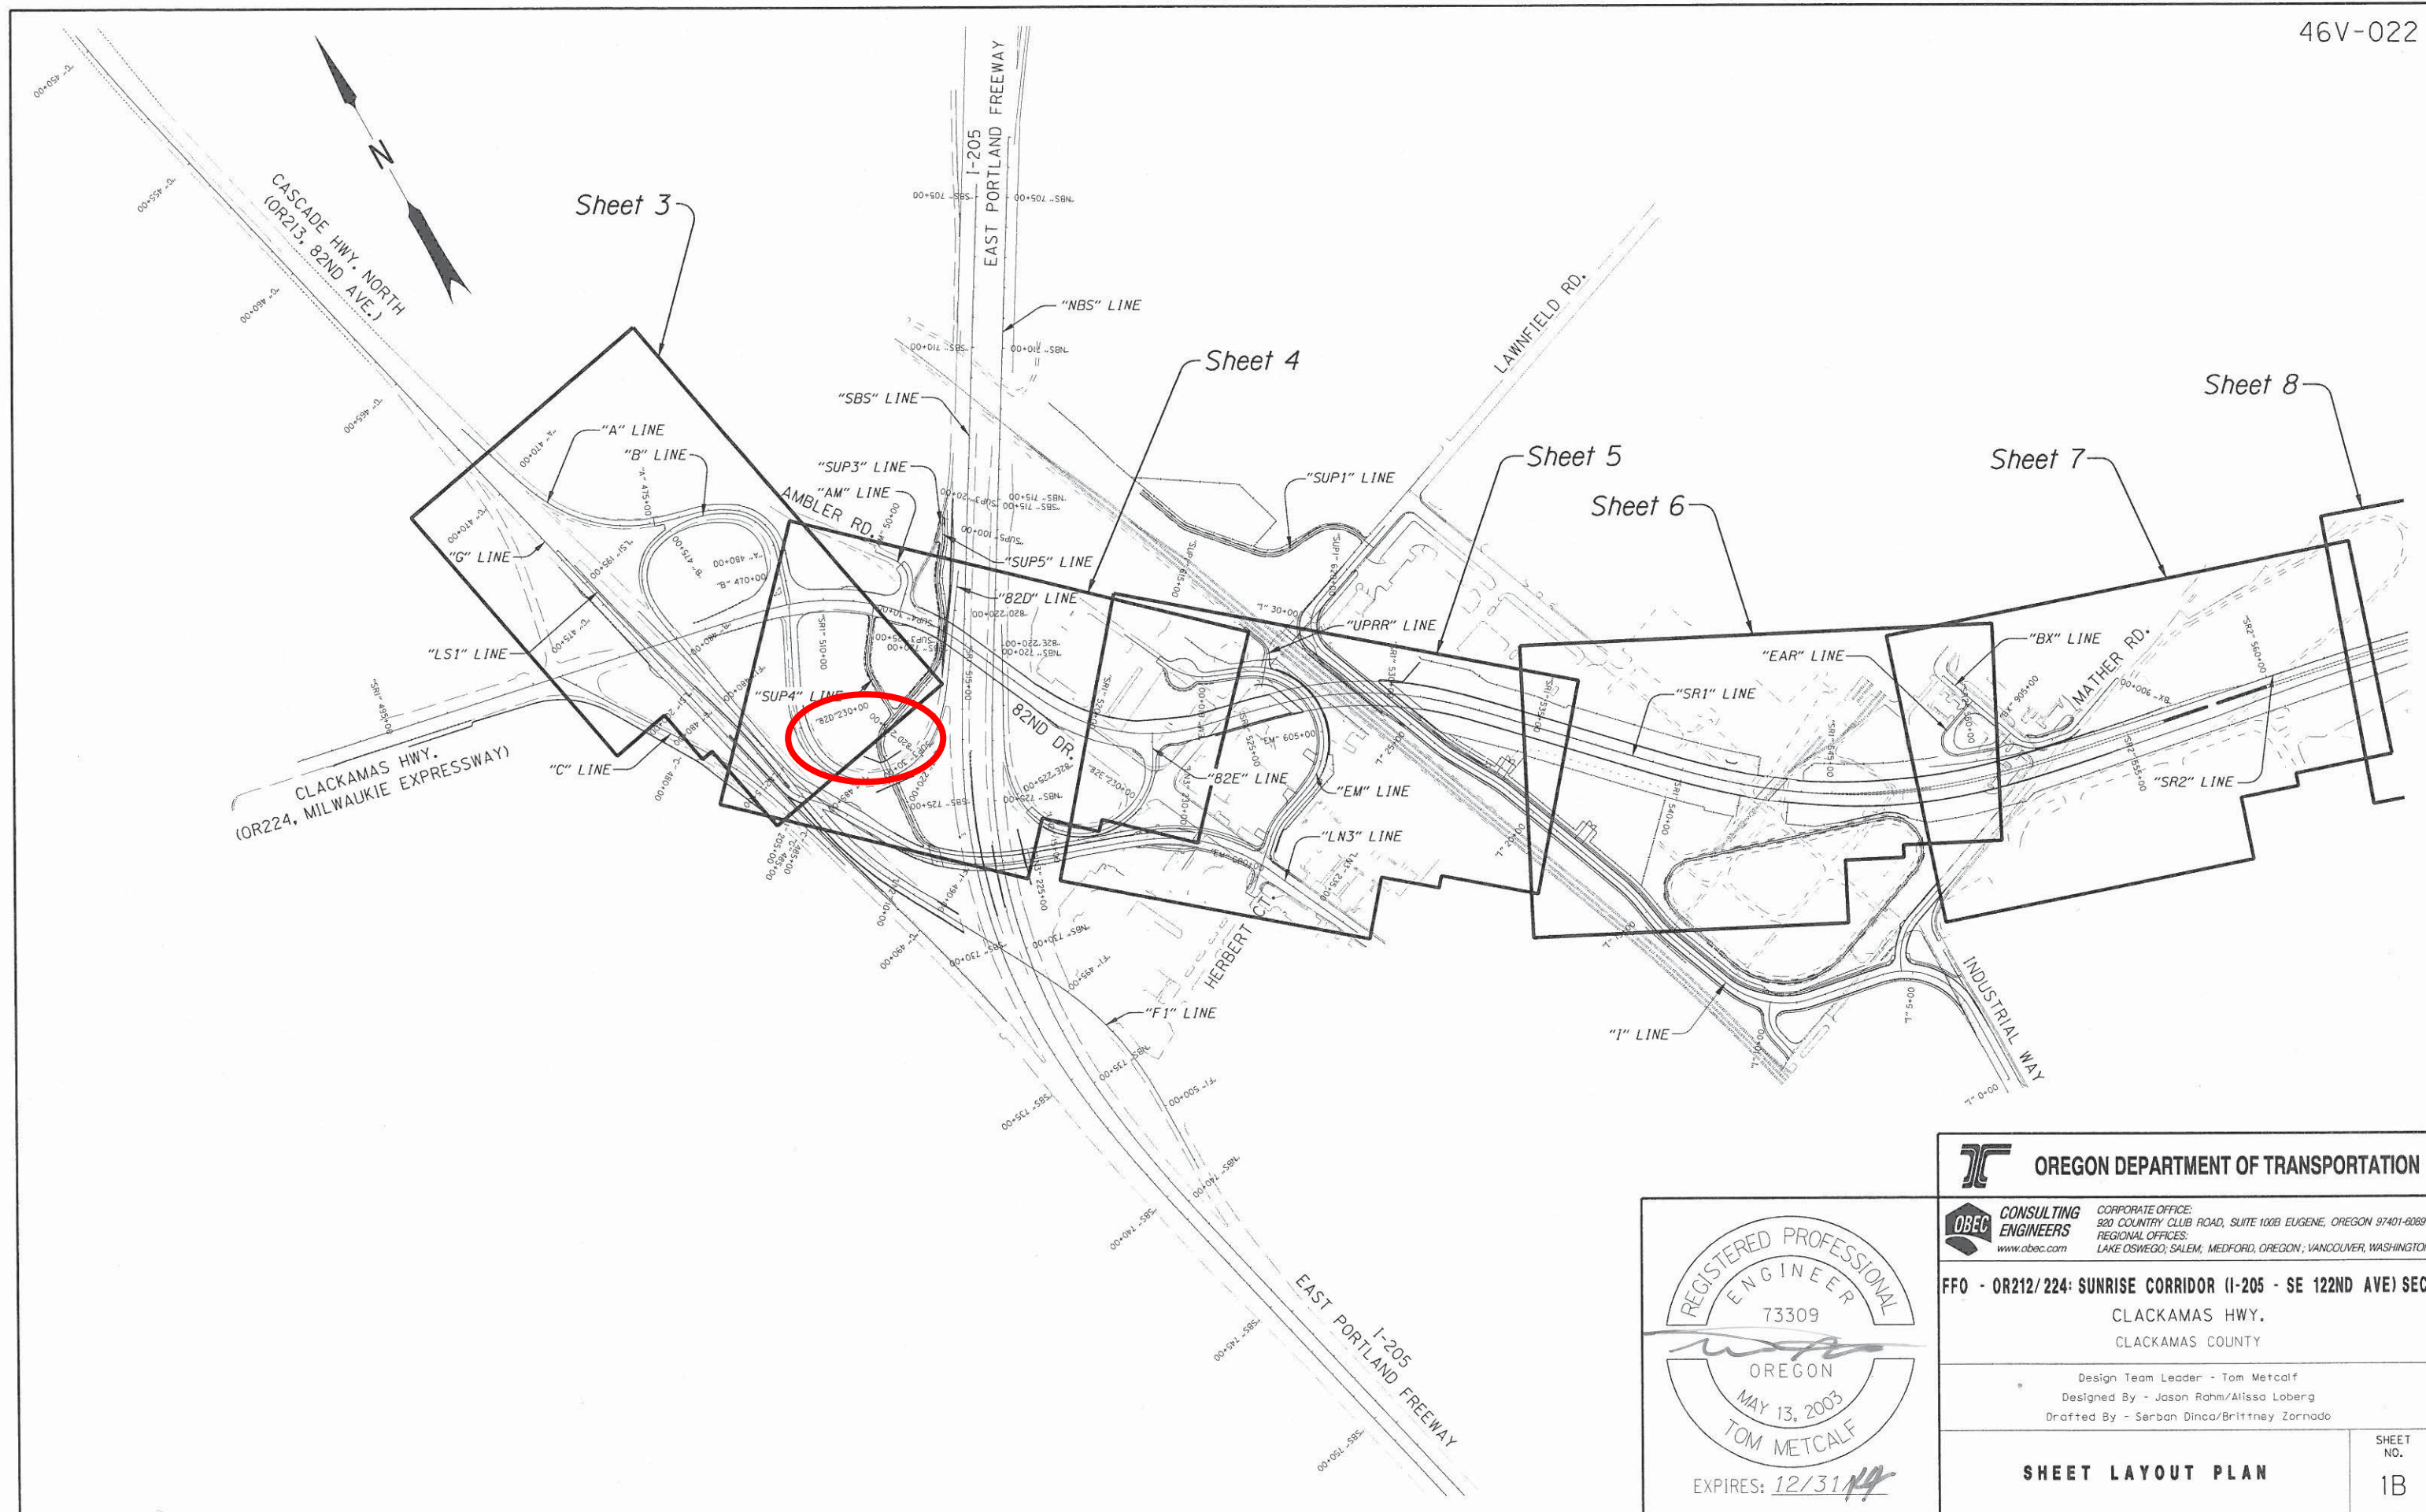

**OREGON DEPARTMENT OF TRANSPORTATION**

**OBEC CONSULTING ENGINEERS**  
 CORPORATE OFFICE: 920 COUNTRY CLUB ROAD, SUITE 100B EUGENE, OREGON 97401-6089  
 REGIONAL OFFICES: LAKE OSWEGO, SALEM, MEDFORD, OREGON; VANCOUVER, WASHINGTON  
 www.obec.com


**FFO - OR212/224: SUNRISE CORRIDOR (I-205 - SE 122ND AVE) SEC.**  
 CLACKAMAS HWY.  
 CLACKAMAS COUNTY

Design Team Leader - Tom Metcalf  
 Designed By - Jason Rahm/Alissa Loberg  
 Drafted By - Serban Dinca/Brittney Zornado

REGISTERED PROFESSIONAL  
 ENGINEER  
 73309  
 OREGON  
 MAY 13, 2003  
 TOM METCALF  
 EXPIRES: 12/31/14

**SHEET LAYOUT PLAN**

SHEET NO.  
 1B

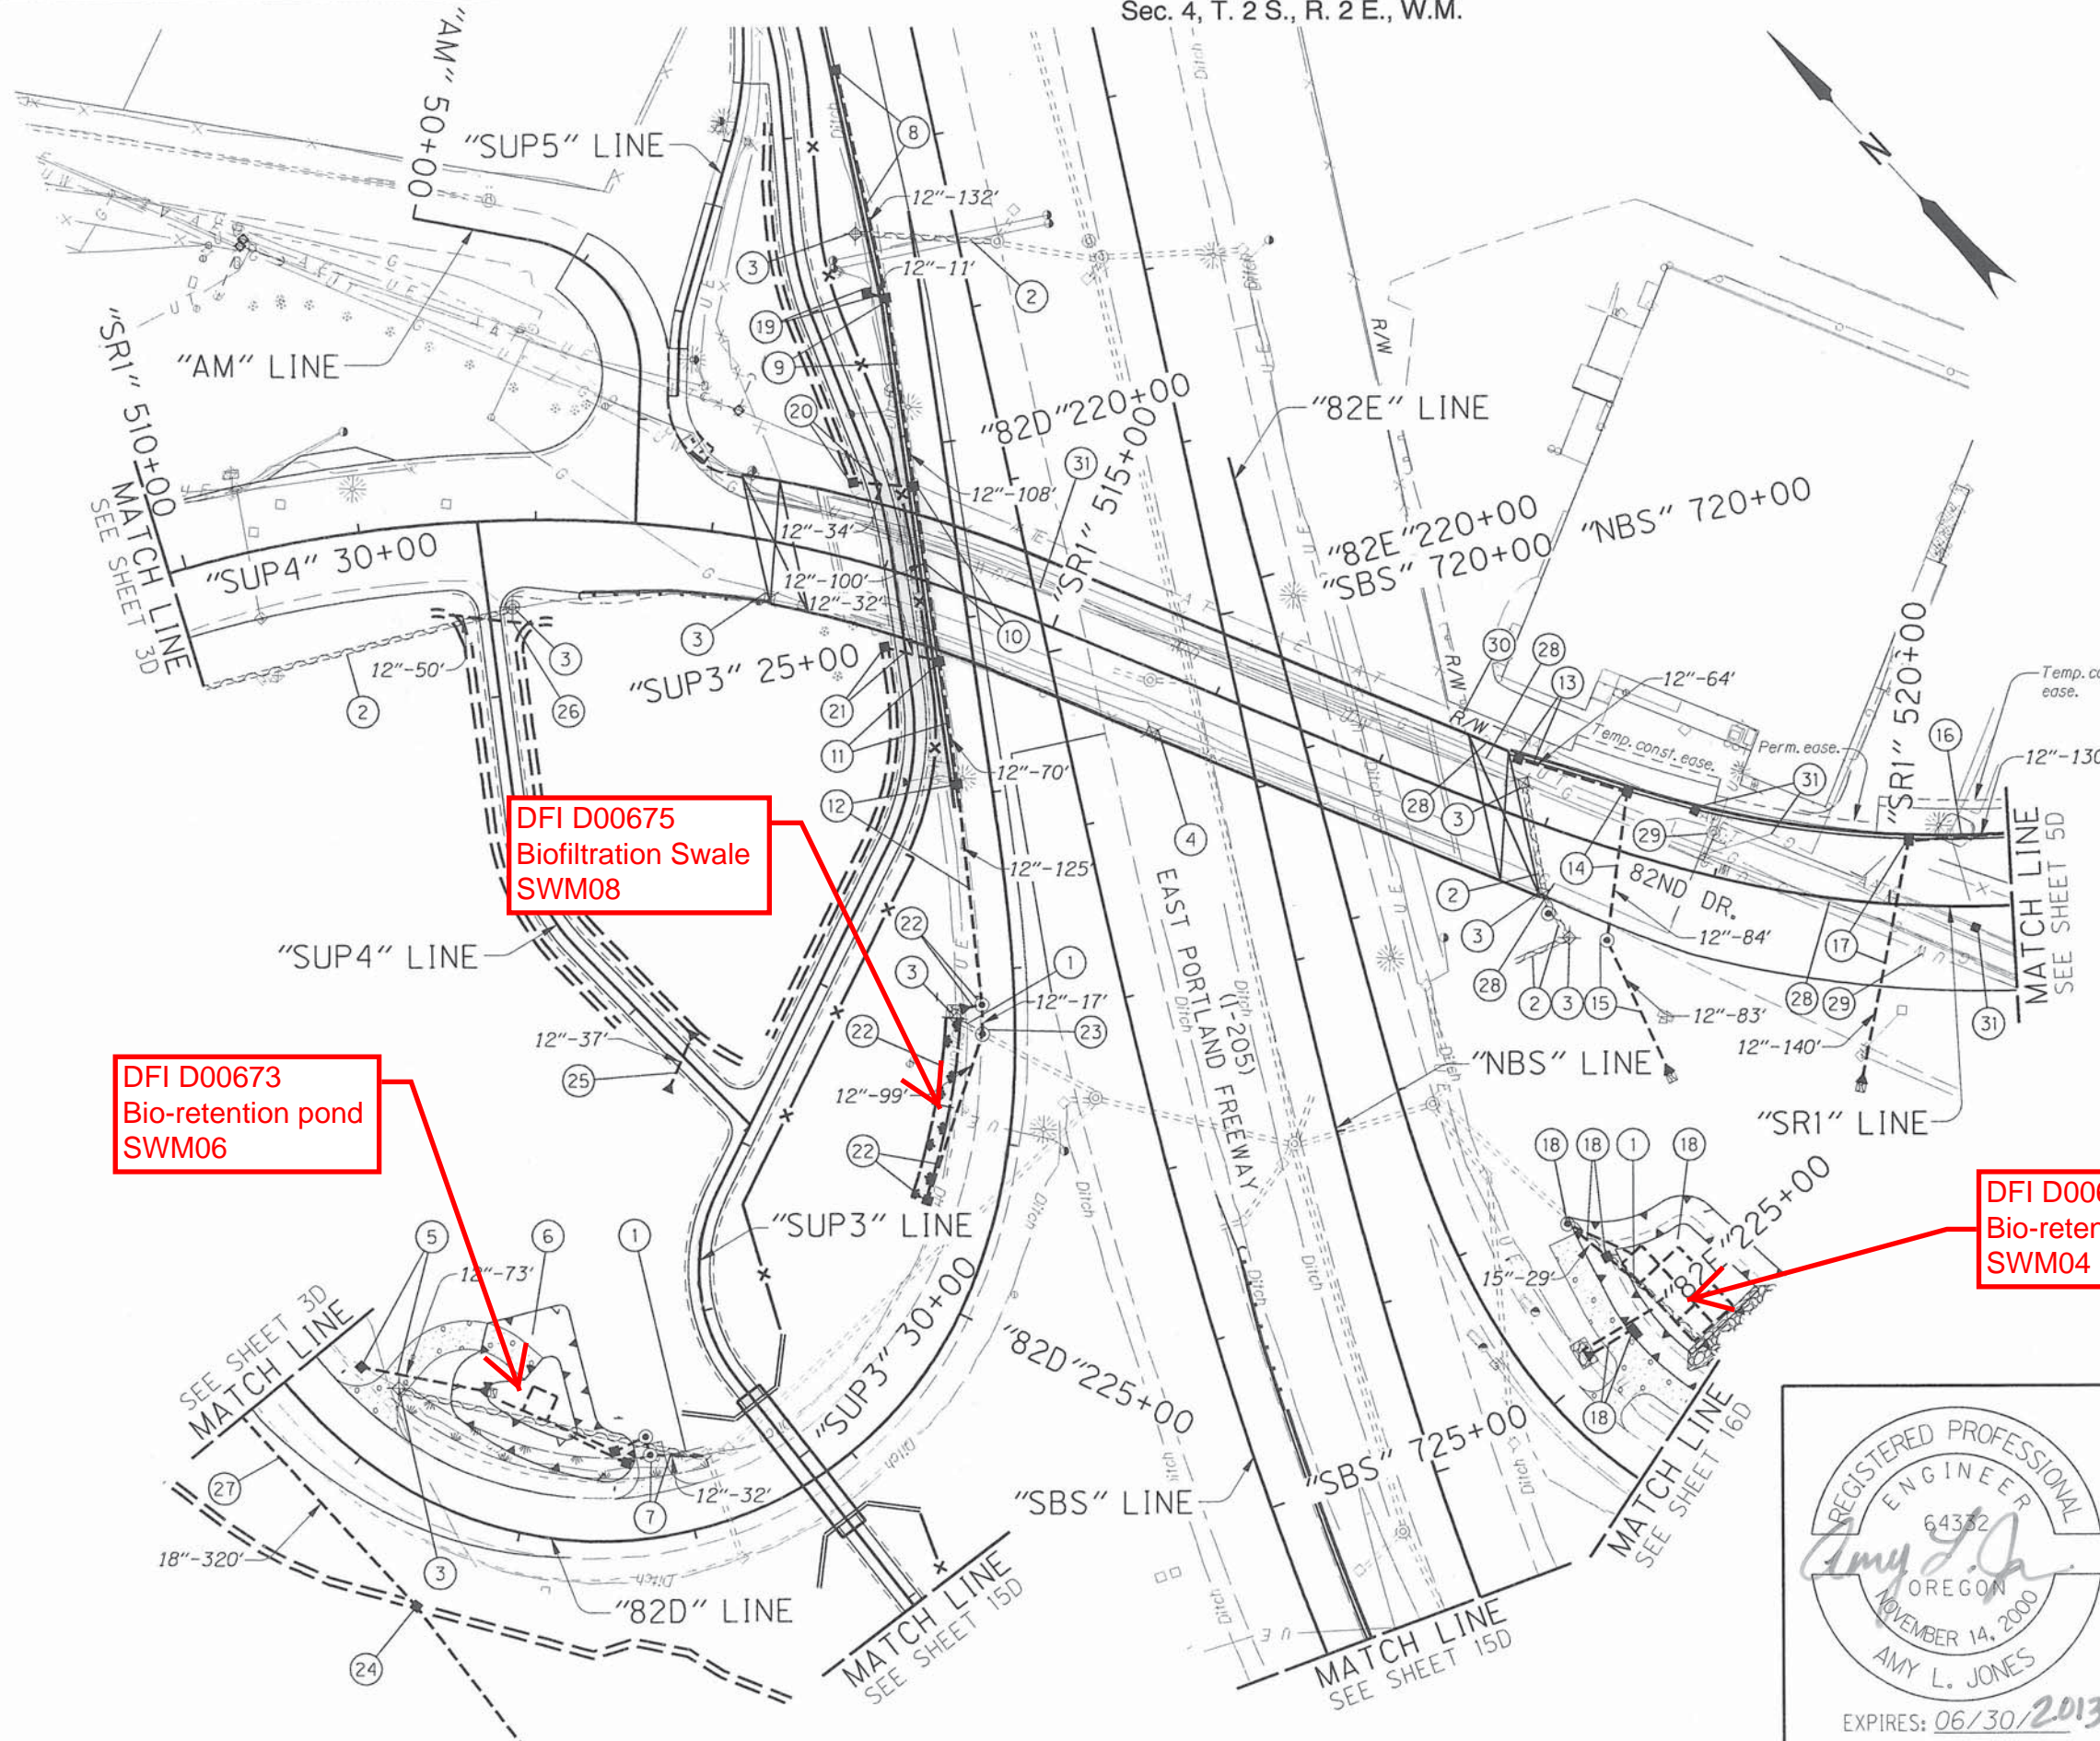

DFI D00675  
Biofiltration Swale  
SWM08


DFI D00673  
Bio-retention pond  
SWM06

DFI D00671  
Bio-retention pond  
SWM04



<b>CONSULTING ENGINEERS</b> <small>www.obec.com</small>	
<small>CORPORATE OFFICE:        920 COUNTRY CLUB ROAD, SUITE 100B EUGENE, OREGON 97401-6089        REGIONAL OFFICES:        LAKE OSWEGO, SALEM, MEDFORD, OREGON; VANCOUVER, WASHINGTON</small>	
<b>FFO - OR212/224: SUNRISE CORRIDOR (I-205 - SE 122ND AVE) SEC.</b> CLACKAMAS HWY. CLACKAMAS COUNTY	
<small>Design Team Leader - Tom Metcalf        Designed By - Ben Wewerka/Amy Jones        Drafted By - Serban Dinco/Brittney Zornado</small>	
<b>DRAINAGE &amp; UTILITIES</b>	SHEET NO. <b>4D</b>

- ① Remove pipe - 408'
- ② Abandon pipe
- ③ Remove inlet - 8
- ④ Abandon inlet
- ⑤ Sta. "82D" 229+36.08, 38.2' Rt.  
Const. type "D" inlet  
Inst. 12" storm sew. pipe - 73'  
5' depth  
Const. sloped end  
Const. paved end slope, Lt.  
Const. riprap basin  
(For details, see sht. GJ-22)
- ⑥ **Const. bio-retention pond, D00673 (SWM06)**  
Inst. facility field markers, type S1 - 2  
Inst. facility field marker, type S2  
Conc. pipe anchor  
Aggregate base - 180 tons  
6" gate valve  
(For details, see shts. GJ-9 & GJ-9A)
- ⑦ Sta. "82D" 227+18.07, 46.5' Rt.  
Const. storm manhole  
Inst. 12" storm sew. pipe - 32'  
5' depth  
Connect to extg. inlet
- ⑧ Sta. "SBS" 716+52.97, 46.11' Rt.  
Const. type "G-2" inlet  
Inst. 12" storm sew. pipe - 132'  
5' depth  
(For profile, see sht. 19B)
- ⑨ Sta. "82D" 219+15.12, 19.1' Rt.  
Const. type "G-2" inlet  
Inst. 12" storm sew. pipe - 108'  
5' depth
- ⑩ Sta. "82D" 220+22.75, 18.9' Rt.  
Const. type "G-2" inlet  
Inst. 12" storm sew. pipe - 100'  
5' depth
- ⑪ Sta. "82D" 221+22.76, 18.9' Rt.  
Const. type "G-2" inlet  
Inst. 12" storm sew. pipe - 70'  
5' depth
- ⑫ Sta. "82D" 221+92.91, 18.9' Rt.  
Const. type "G-2" inlet  
Inst. 12" storm sew. pipe - 125'  
5' depth
- ⑬ Sta. "SR1" 517+72.57, 30.5' Lt.  
Const. type "G-2" inlet  
Inst. 12" storm sew. pipe - 64'  
5' depth
- ⑭ Sta. "SR1" 518+38.71, 32.9' Lt.  
Const. type "G-2" inlet  
Inst. 12" storm sew. pipe - 84'  
10' depth
- ⑮ Sta. "SR1" 518+51.89, 50.4' Rt.  
Const. storm manhole  
Inst. 12" storm sew. pipe - 83'  
5' depth  
Const. sloped end  
Const. paved end slope, Rt.  
Const. riprap basin  
(For details, see sht. GJ-22)
- ⑯ Sta. "SR1" 520+09.32, 36.2' Lt. to Sta. "SR1" 521+47.84, 38' Lt.  
Inst. 12" storm sew. pipe - 130'  
5' depth
- ⑰ Sta. "SR1" 520+09.32, 36.2' Lt.  
Const. type "G-2" inlet  
Inst. 12" storm sew. pipe - 140'  
10' depth  
Const. sloped end  
Const. paved end slope, Rt.  
Const. riprap basin  
(For details, see sht. GJ-22)
- ⑱ Const. bio-retention pond, D00671 (SWM04)  
Inst. facility field markers, type S1 - 2  
Inst. facility field marker, type S2  
Conc. pipe anchor  
Aggregate base - 275 tons  
6" gate valve  
Const. sloped end  
Const. paved end slope, Lt.  
(For details, see shts. GJ-7 & GJ-7A)
- ⑲ Sta. "82D" 219+10.58, 29.5' Rt.  
Const. type "G-2M" inlet  
Inst. 12" storm sew. pipe - 11'  
5' depth
- ⑳ Sta. "82D" 220+15.49, 52.2' Rt.  
Const. type "G-2M" inlet  
Inst. 12" storm sew. pipe - 34'  
5' depth
- ㉑ Sta. "82D" 221+10.54, 48.2' Rt.  
Const. type "G-2M" inlet  
Inst. 12" storm sew. pipe - 32'  
5' depth
- ㉒ Sta. "82D" 223+34 to Sta. "82D" 224+45, Rt.  
Const. water quality swale, D00675 (SWM08)  
Inst. facility field marker, type S1 - 2  
Inst. facility field marker, type S2  
Const. paved end slope, Rt.  
(For details, see sht. GJ-11)
- ㉓ Sta. "82D" 223+37.42, 18.28' Rt.  
Const. storm manhole over extg. storm sew. pipe  
Inst. 12" storm sew. pipe - 17'  
5' depth
- ㉔ Sta. "82D" 228+38.20, 57.27' Lt.  
Const. type "D" inlet
- ㉕ Sta. "SUP3" 27+55.5, 51.54' Rt. to Sta. "SUP3" 27+92.6, 49.91' Rt.  
Inst. 12" culv. pipe - 37'  
5' depth  
Const. sloped end - 2  
Const. paved end slope, Lt. & Rt.  
(For profile, see sht. 19C)
- ㉖ Sta. "SR1" 511+44.88, 51.4' Rt. to Sta. "SR1" 511+98.64, 59' Rt.  
Inst. 12" culv. pipe - 50'  
5' depth  
Const. sloped end, Lt. & Rt.
- ㉗ See sht. 3D, note 26  
Inst. 18" storm sew. pipe
- ㉘ Preserve and protect gas line
- ㉙ Relocate waterline  
(For details, see sht. WA-N2a)
- ㉚ Preserve and protect pole
- ㉛ Utilities relocated prior to construction

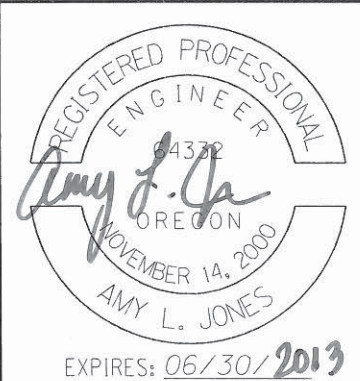


**OREGON DEPARTMENT OF TRANSPORTATION**

**OBEC CONSULTING ENGINEERS**  
CORPORATE OFFICE: 920 COUNTRY CLUB ROAD, SUITE 100B EUGENE, OREGON 97401-8089  
REGIONAL OFFICES: LAKE OSWEGO; SALEM; MEDFORD, OREGON; VANCOUVER, WASHINGTON  
www.obec.com


**FFO - OR212/224: SUNRISE CORRIDOR (I-205 - SE 122ND AVE) SEC.**  
CLACKAMAS HWY.  
CLACKAMAS COUNTY

Design Team Leader - Tom Metcalf  
Designed By - Ben Wewerka/Amy Jones  
Drafted By - Serban Dinco/Brittney Zornado


**DRAINAGE & UTILITIES NOTES**  
SHEET NO. 4E

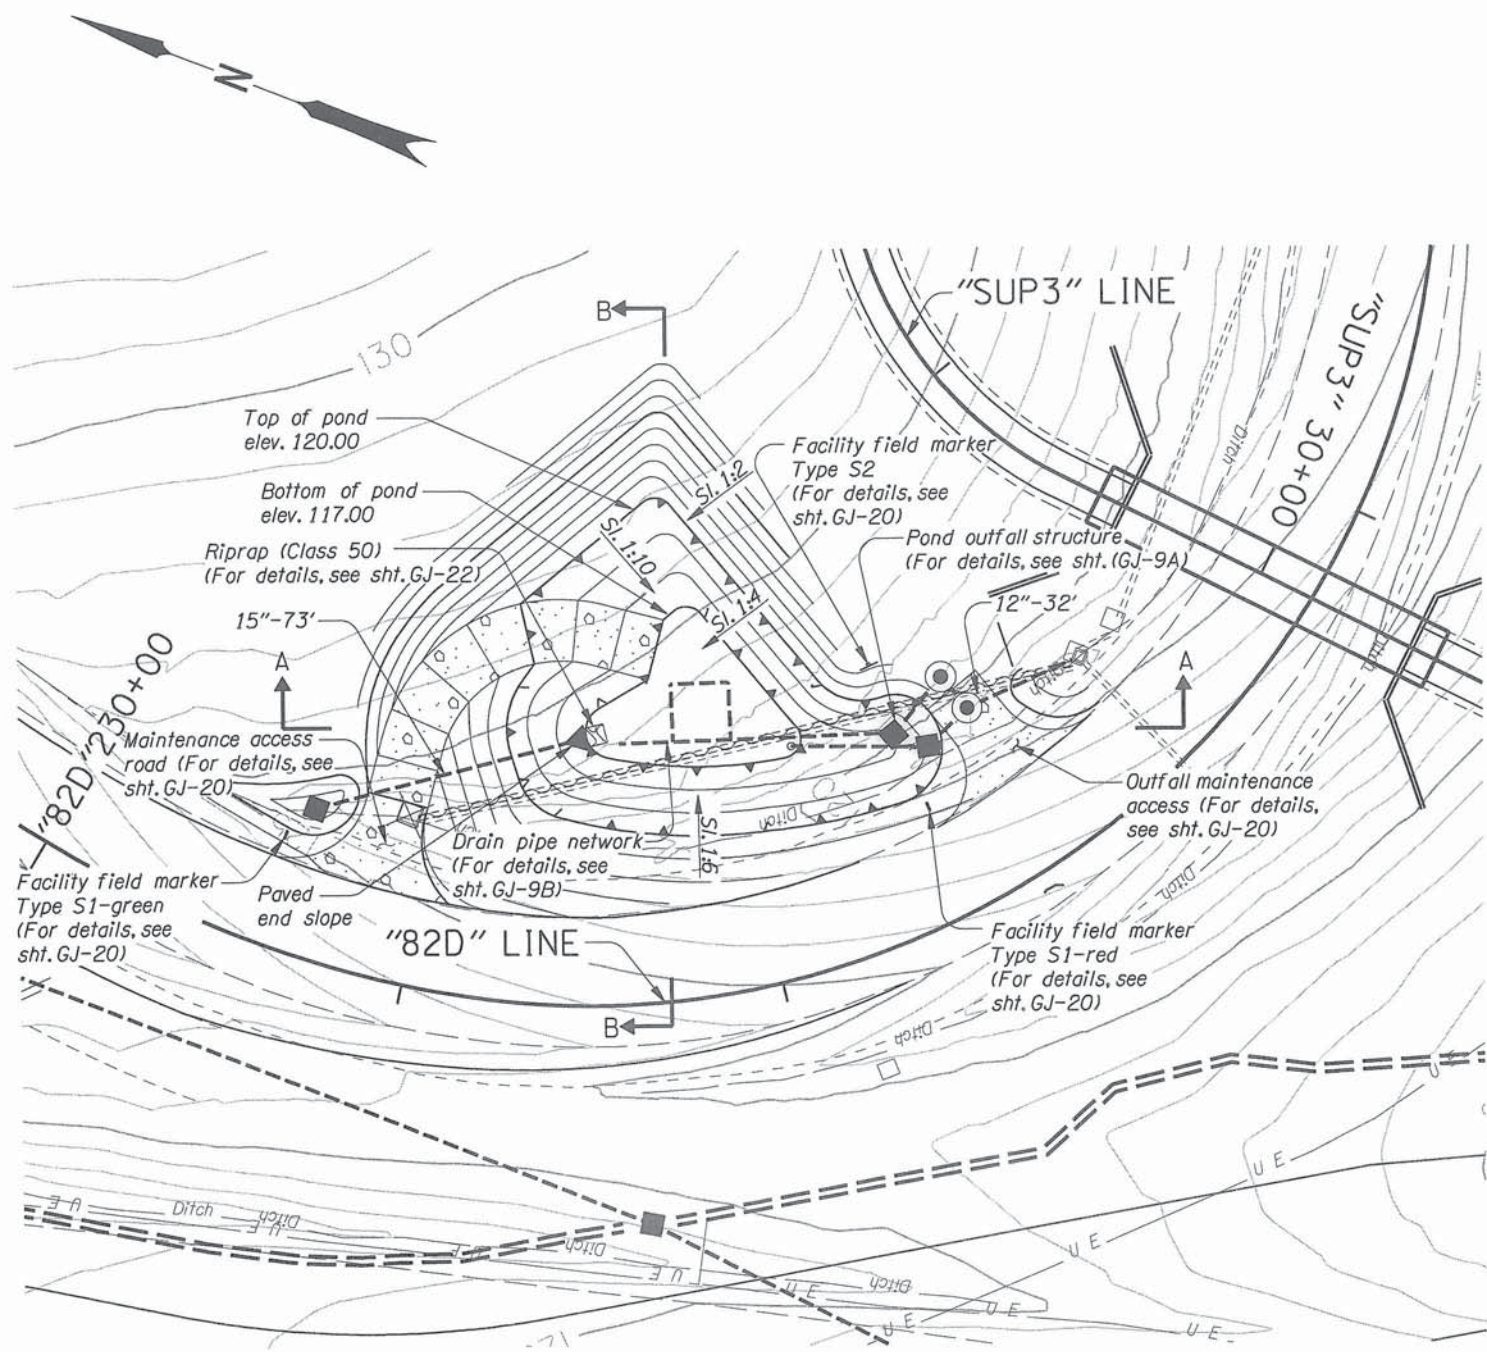

"SWM06" BIORETENTION POND  
DF I-00673

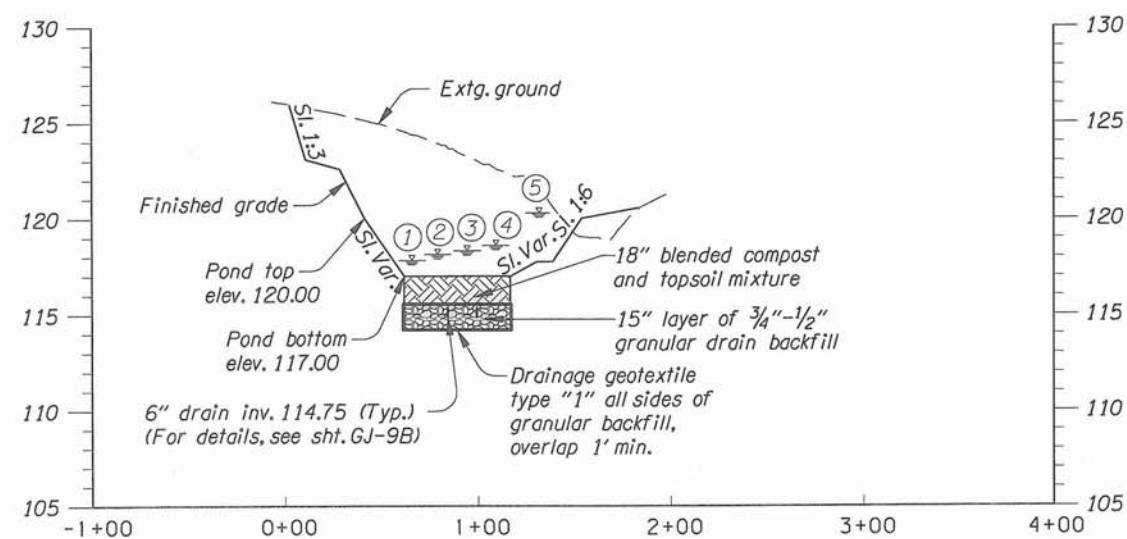


SECTION A-A

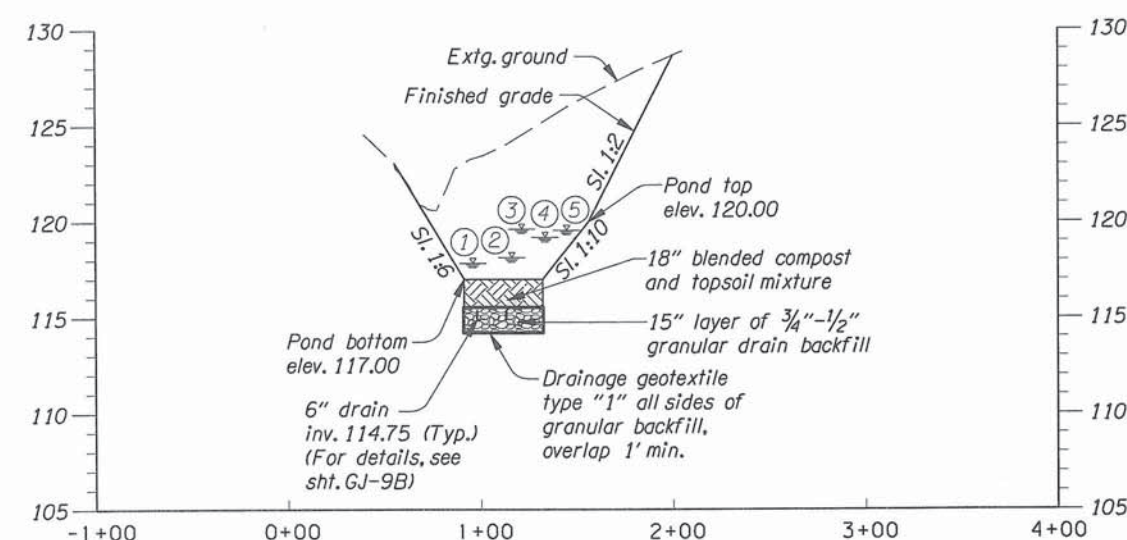


SECTION B-B

- ① Water quality WSE - 117.84
- ② 2 year WSE - 118.06
- ③ 10 year WSE - 118.26
- ④ 25 year WSE - 118.30
- ⑤ 100 year WSE - 119.37  
(Via emergency spillway only)

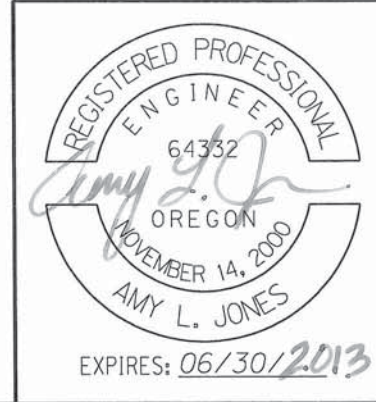


<b>OREGON DEPARTMENT OF TRANSPORTATION</b>	
<b>OBEC CONSULTING ENGINEERS</b> www.obec.com	<small>CORPORATE OFFICE: 920 COUNTRY CLUB ROAD, SUITE 100B EUGENE, OREGON 97401-6089 REGIONAL OFFICES: LAKE OSWEGO, SALEM, MEDFORD, OREGON; VANCOUVER, WASHINGTON</small>
<b>FFO - OR212/224: SUNRISE CORRIDOR (I-205 - SE 122ND AVE) SEC.</b>	
CLACKAMAS HWY. CLACKAMAS COUNTY	
Design Team Leader - Tom Metcalf Designed By - Ben Wewerka/Amy Jones Drafted By - Serban Dinca/Brittney Zornado	
<b>STORMWATER DETAILS</b>	SHEET NO. <b>GJ-9</b>



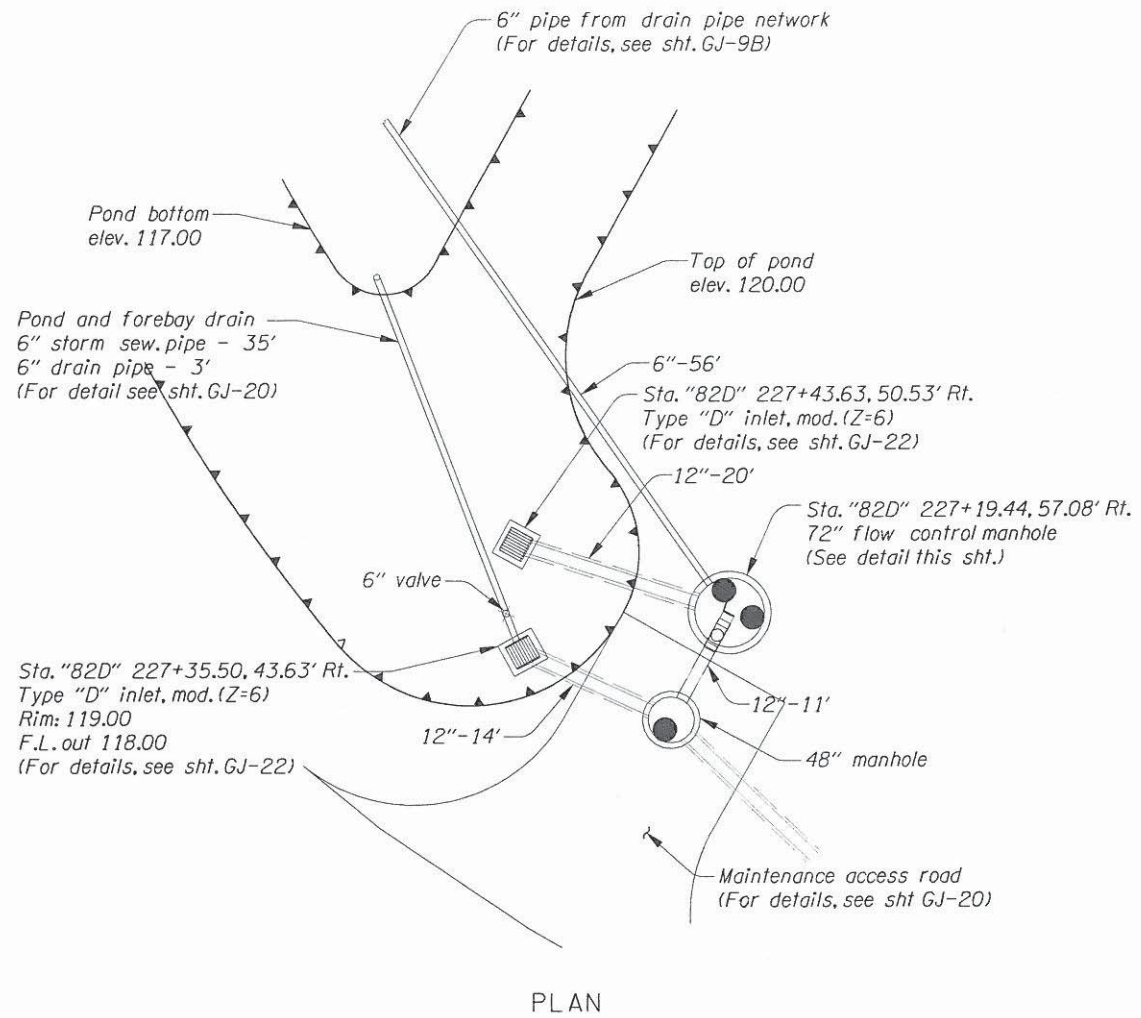


PLAN

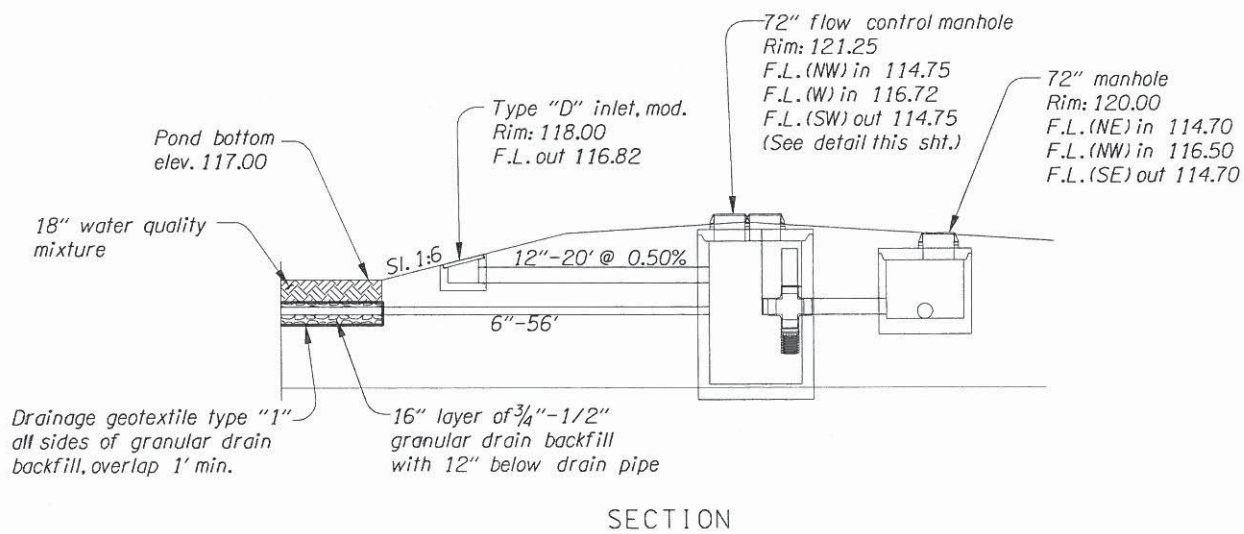


SECTION

"SWM06" OUTFALL STRUCTURE DETAIL  
DFI-00673

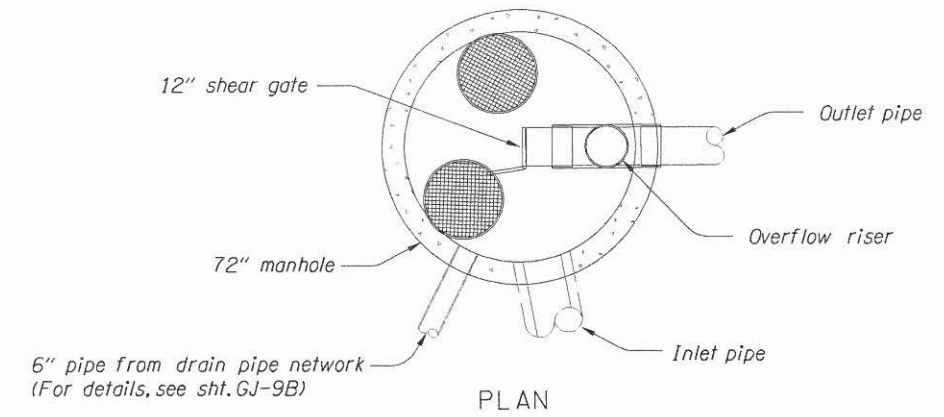


PLAN

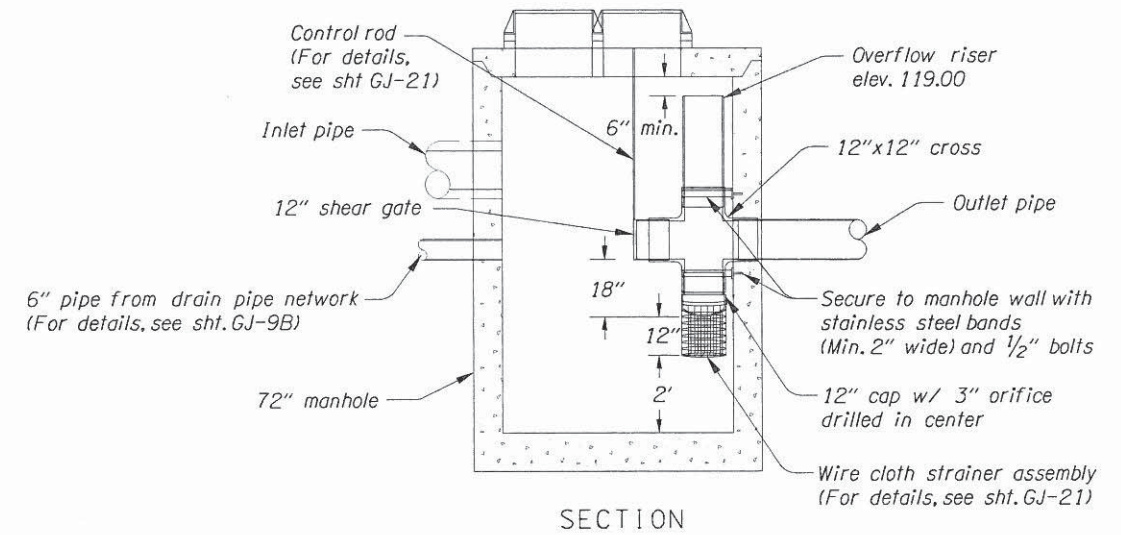

SECTION

FLOW CONTROL MANHOLE

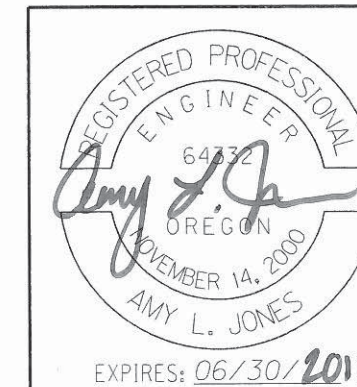

**OREGON DEPARTMENT OF TRANSPORTATION**


**OBEC CONSULTING ENGINEERS**  
CORPORATE OFFICE: 920 COUNTRY CLUB ROAD, SUITE 100B EUGENE, OREGON 97401-6089  
REGIONAL OFFICES: LAKE OSWEGO, SALEM; MEDFORD, OREGON; VANCOUVER, WASHINGTON  
www.obec.com

**FFO - OR212/224: SUNRISE CORRIDOR (I-205 - SE 122ND AVE) SEC.**  
CLACKAMAS HWY.  
CLACKAMAS COUNTY


Design Team Leader - Tom Metcalf  
Designed By - Ben Wewerka/Amy Jones  
Drafted By - Serban Dinco/Brittney Zornado

**STORMWATER DETAILS**

SHEET NO.  
**GJ-9A**

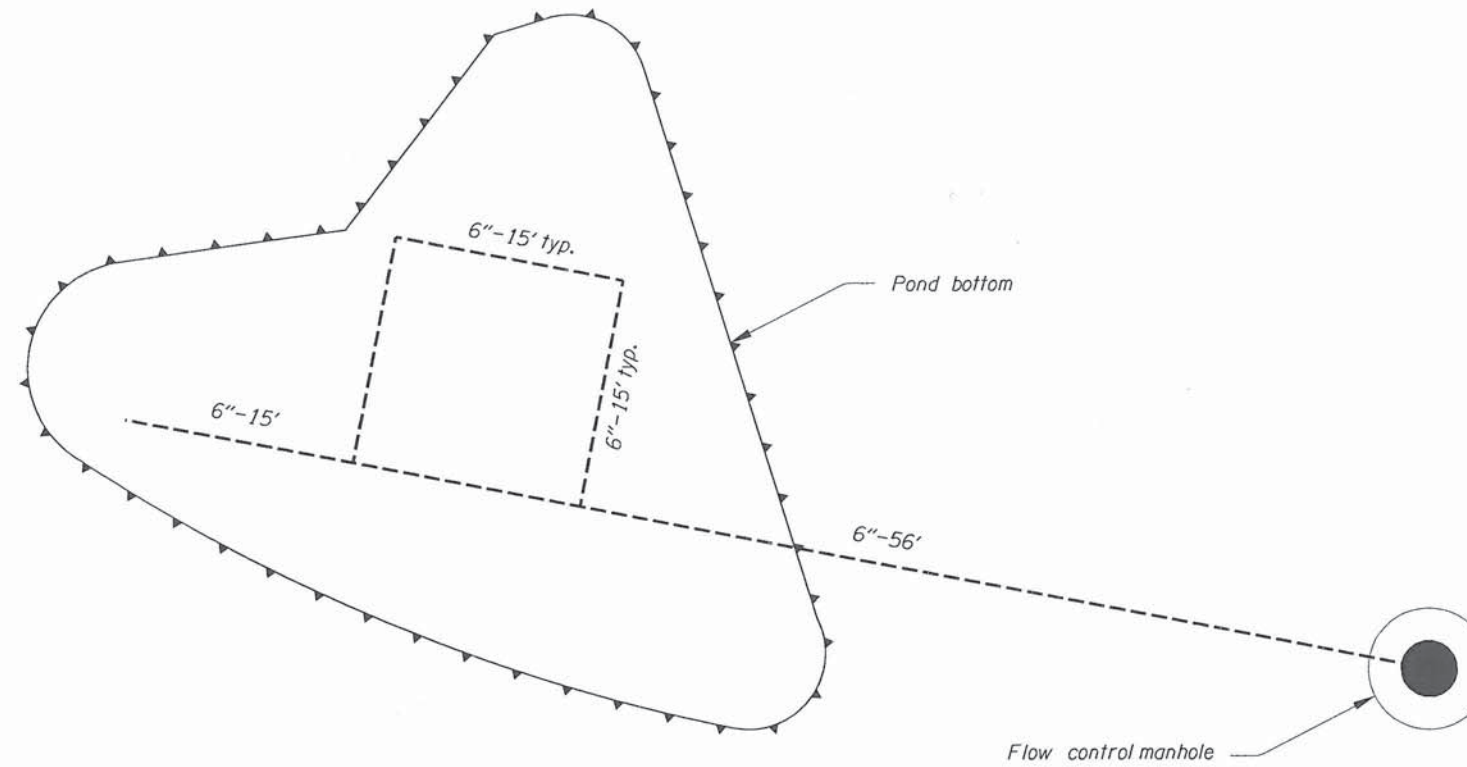

"SWM06" PIPE NETWORK DETAIL  
DFI-00673

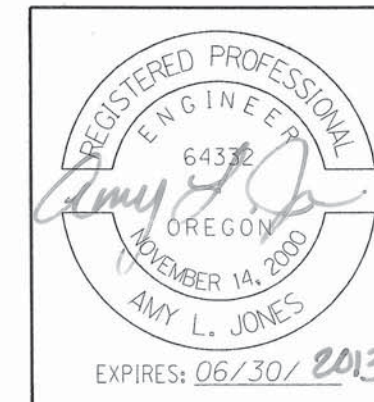

<b>CONSULTING ENGINEERS</b> <small>www.obec.com</small>	
<small>CORPORATE OFFICE:                  920 COUNTRY CLUB ROAD, SUITE 100B EUGENE, OREGON 97401-6089                  REGIONAL OFFICES:                  LAKE OSWEGO, SALEM, MEDFORD, OREGON; VANCOUVER, WASHINGTON</small>	
<b>FFO - OR212/224: SUNRISE CORRIDOR (I-205 - SE 122ND AVE) SEC.</b> CLACKAMAS HWY. CLACKAMAS COUNTY	
Design Team Leader - Tom Metcalf Designed By - Ben Wewerka/Amy Jones Drafted By - Serban Dinco/Brittney Zornado	
<b>STORMWATER DETAILS</b>	SHEET NO. <b>GJ-9B</b>